


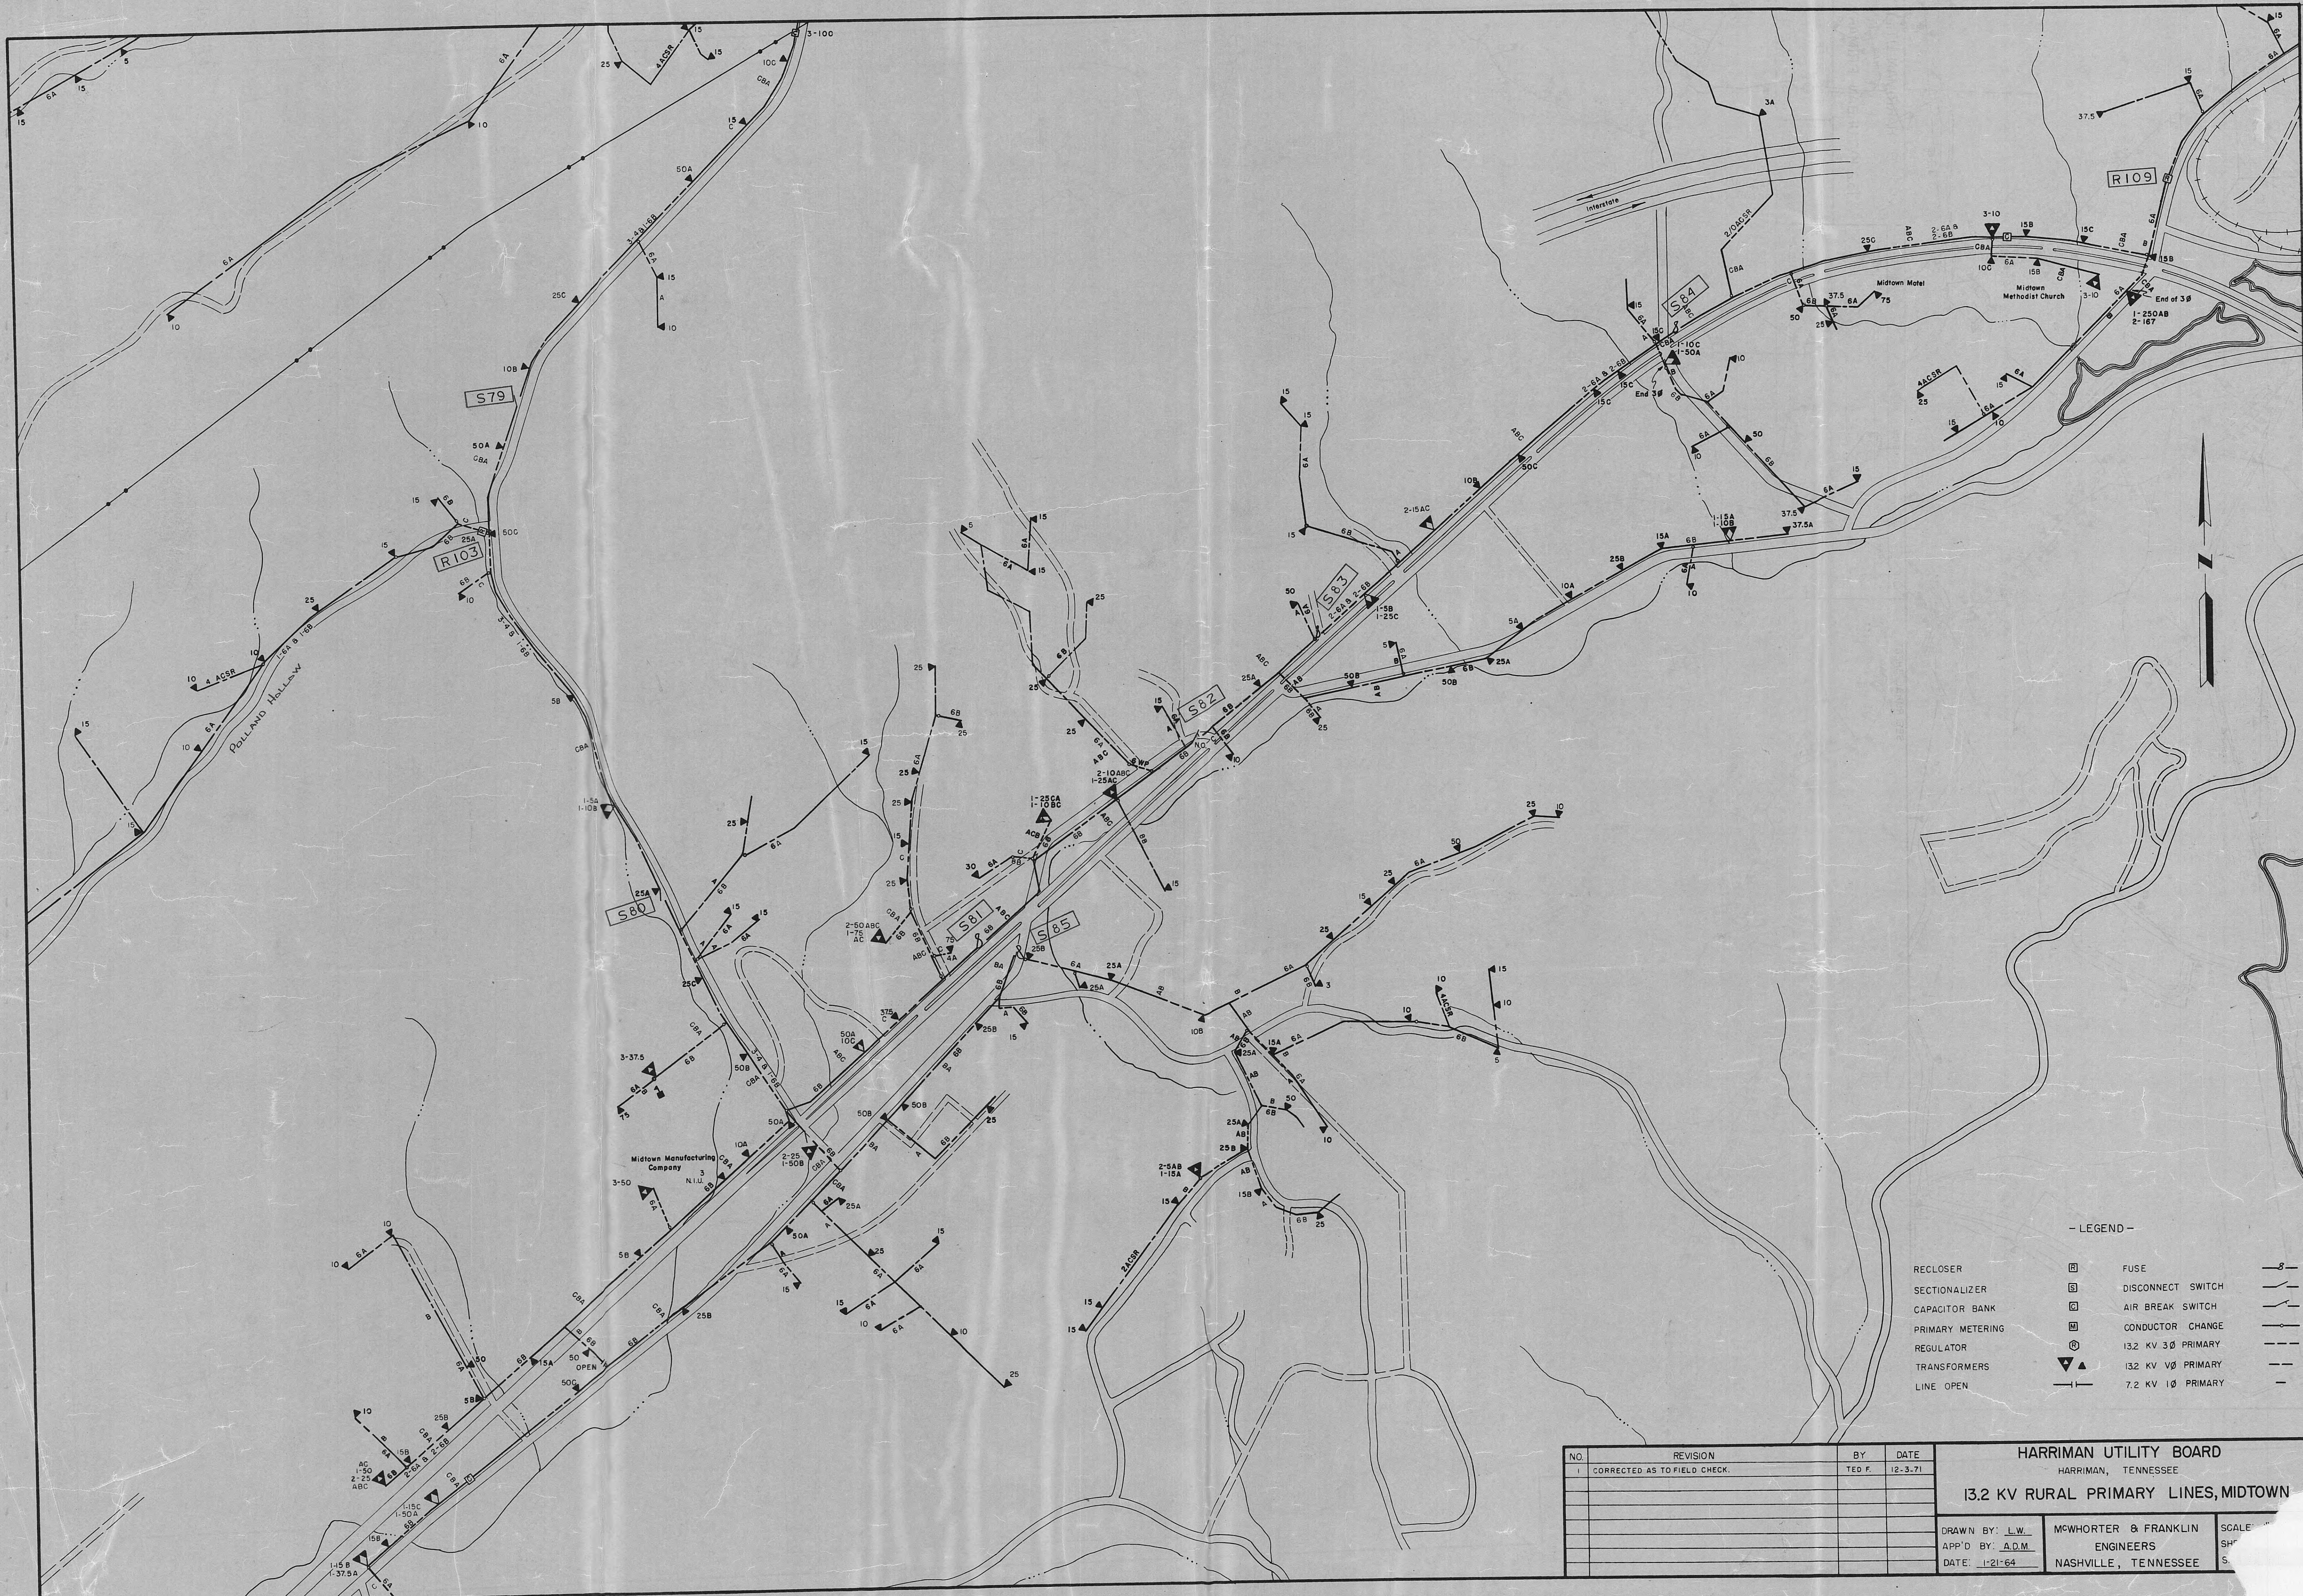

- LEGEND -

- | | | | |
|------------------|---|--------------------|---|
| RECLOSER | □ | FUSE | — |
| SECTIONALIZER | □ | DISCONNECT SWITCH | — |
| CAPACITOR BANK | □ | AIR BREAK SWITCH | — |
| PRIMARY METERING | □ | CONDUCTOR CHANGE | — |
| REGULATOR | □ | 13.2 KV 3Ø PRIMARY | — |
| TRANSFORMERS | ▲ | 13.2 KV VØ PRIMARY | — |
| LINE OPEN | — | 7.2 KV 1Ø PRIMARY | — |

NO.	REVISION	BY	DATE
1	CORRECTED AS TO FIELD CHECK.	TED F.	12-3-71

HARRIMAN UTILITY BOARD
HARRIMAN, TENNESSEE

13.2 KV RURAL PRIMARY LINES, MIDTOWN

DRAWN BY: L.W.
APP'D BY: A.D.M.
DATE: 1-21-64

MCWHORTER & FRANKLIN
ENGINEERS
NASHVILLE, TENNESSEE

SCALE
S.