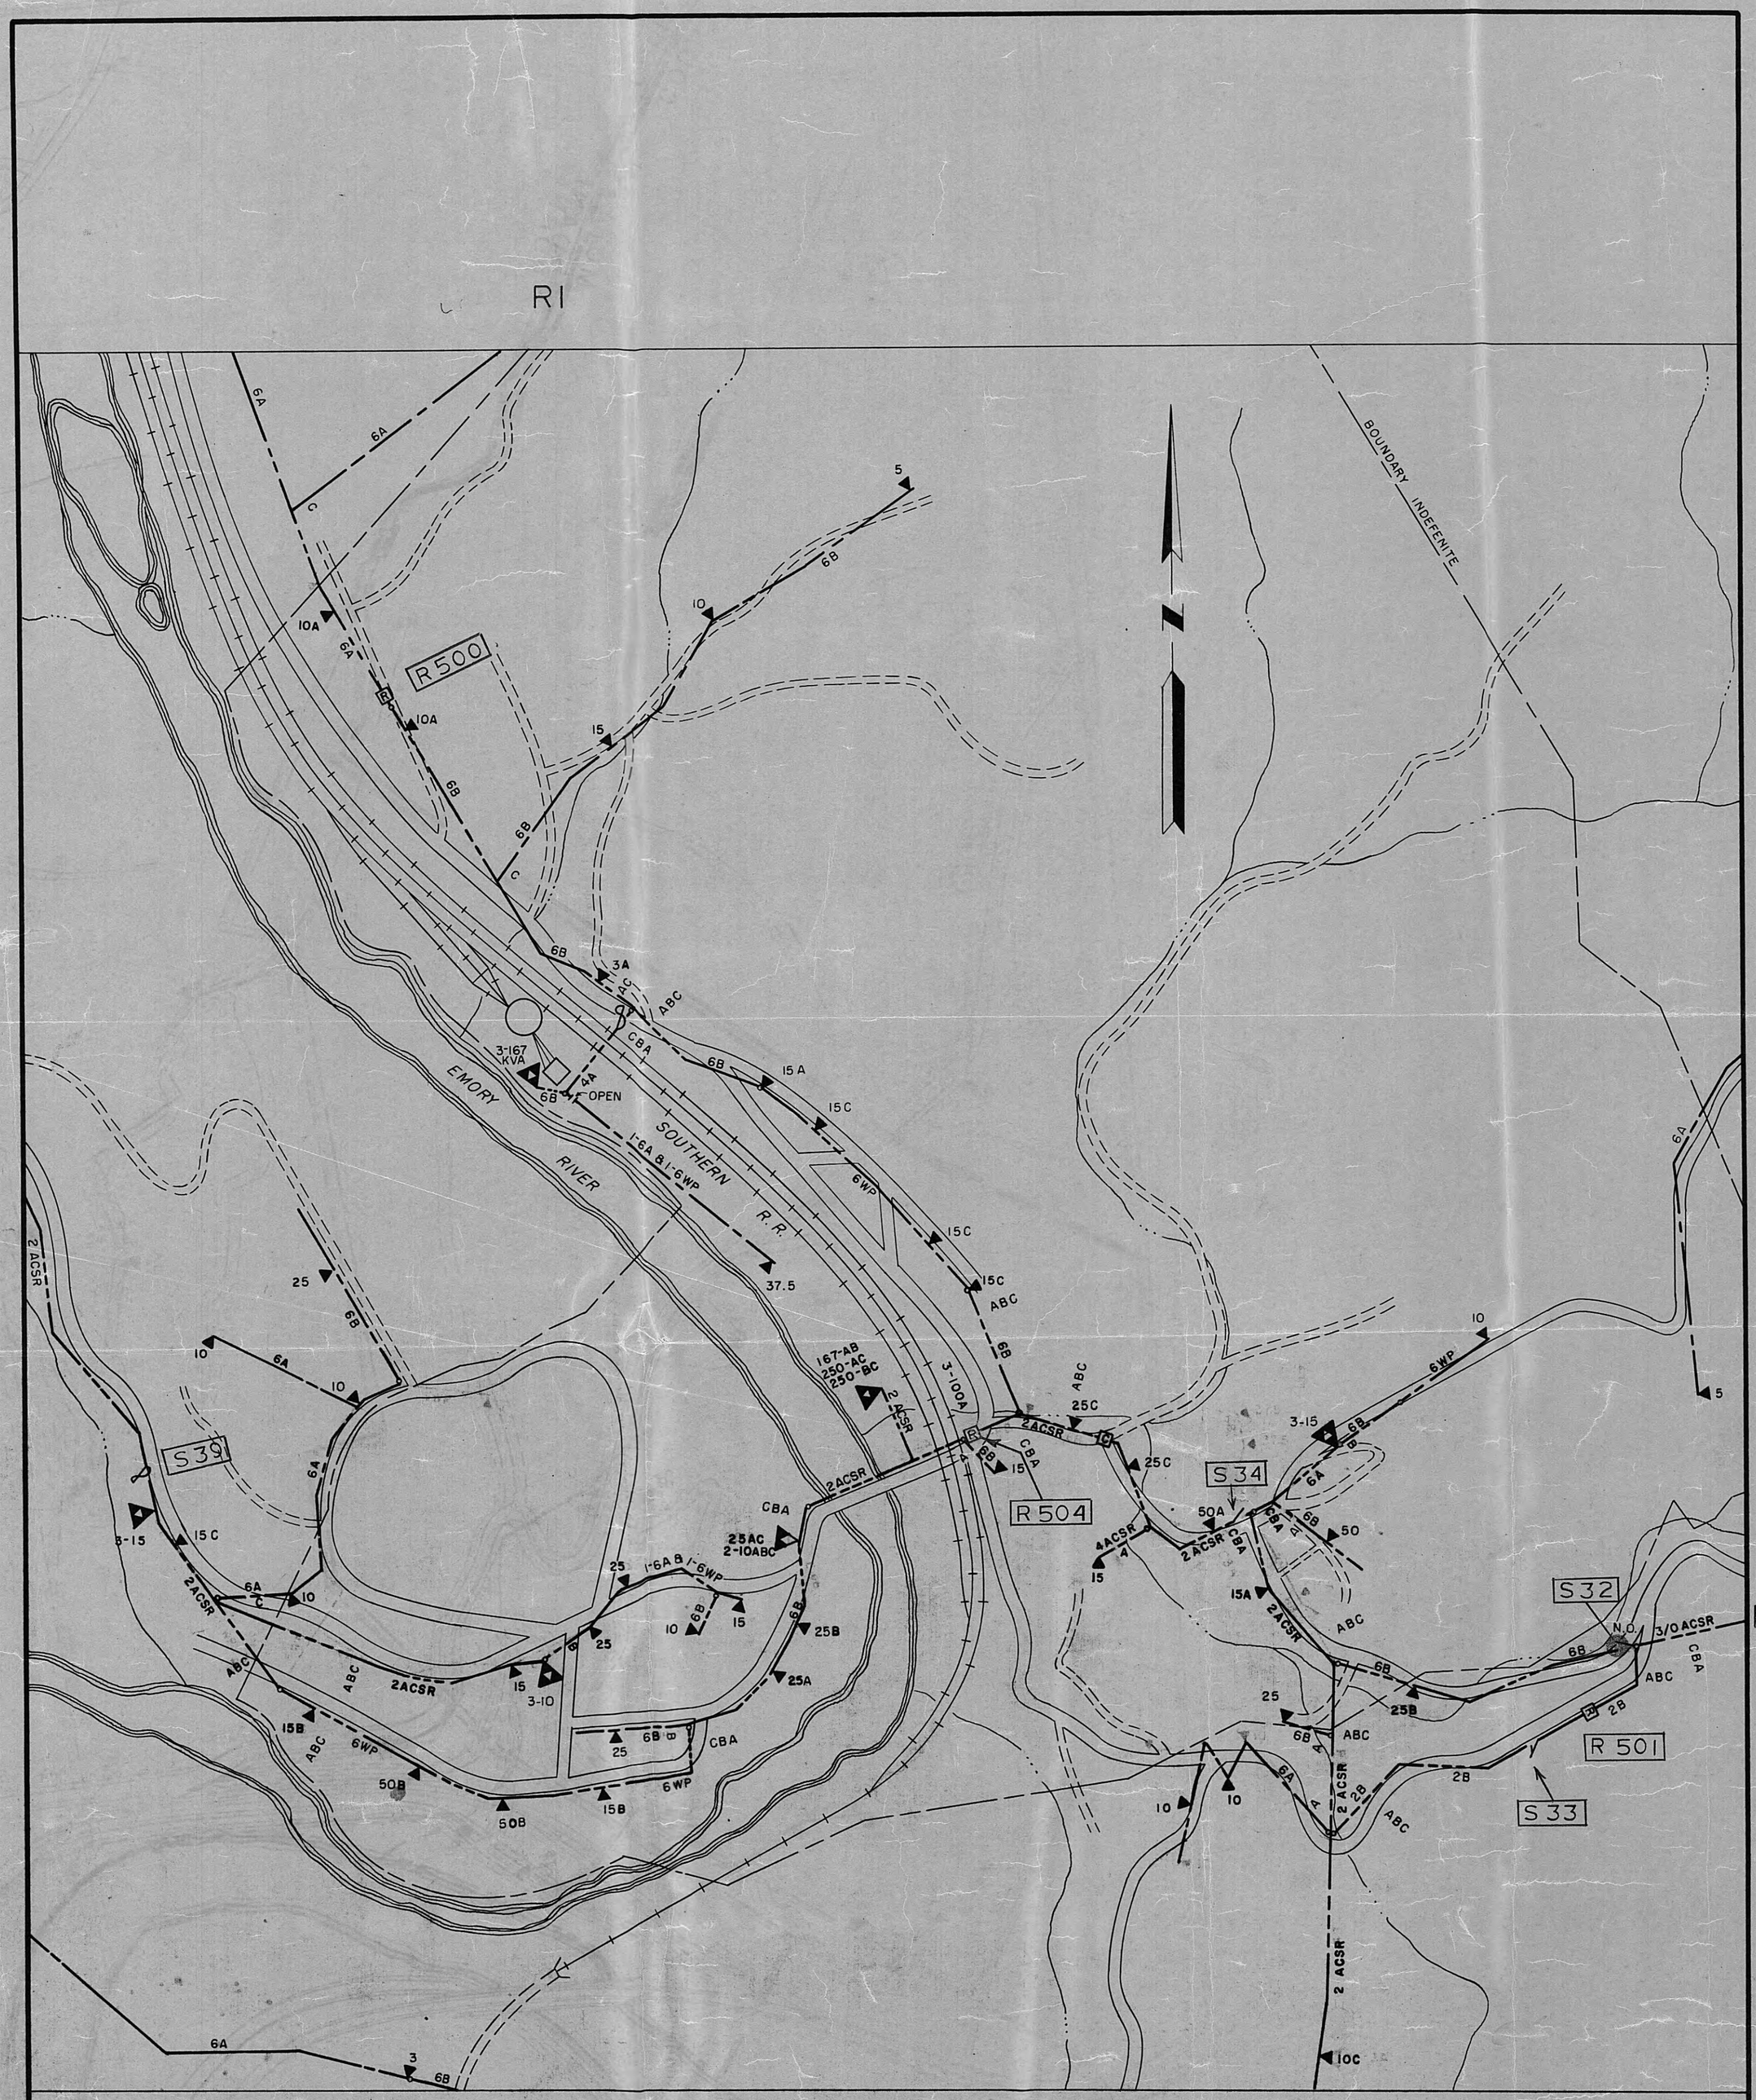

— LEGEND —

RECLOSER	R	FUSE	—8—
SECTIONALIZER	S	DISCONNECT SWITCH	—/—
CAPACITOR BANK	C	AIR BREAK SWITCH	—/—
PRIMARY METERING	M	CONDUCTOR CHANGE	—o—
REGULATOR	R	13.2 KV 3Ø PRIMARY	———
TRANSFORMERS	▼▲	13.2 KV VØ PRIMARY	——
LINE OPEN	—||—	7.2 KV 1Ø PRIMARY	—

R1

NO.	REVISION	BY	DATE
1	CORRECTED AS TO FIELD CHECK.	TED F.	12-3-71

HARRIMAN UTILITY BOARD
HARRIMAN, TENNESSEE

13.2 KV RURAL PRIMARY LINES, OAKDALE

DRAWN BY: I.R.
APP'D BY: A.D.M.
DATE: 1-21-64

McWHORTER & FRANKLIN
ENGINEERS
NASHVILLE, TENNESSEE

SCALE: 1"=400'
SHEET 1 OF 1
SHEETS R-3

19"x30"