



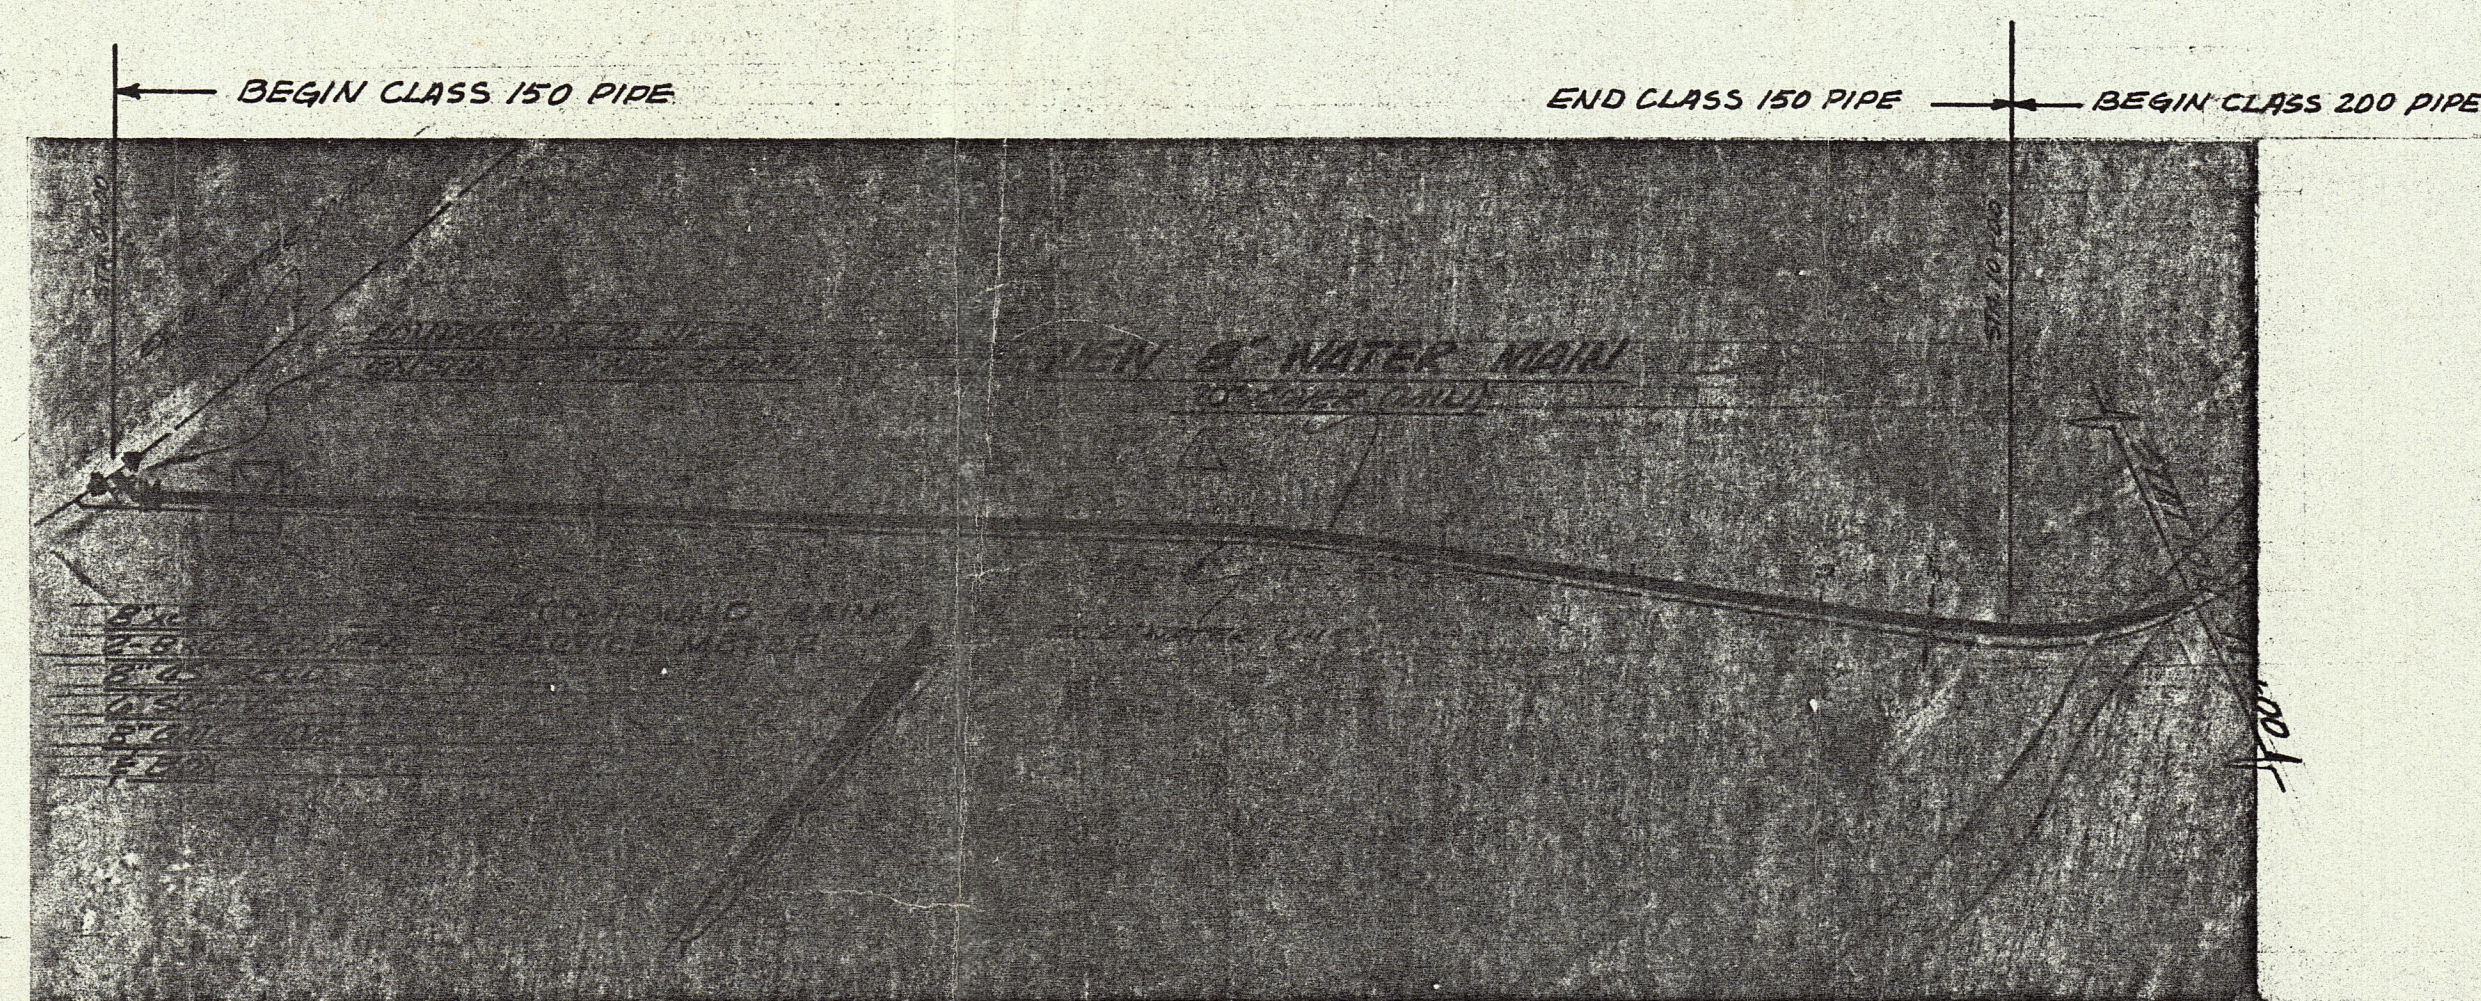


NOTE: CONTRACTOR TO FURNISH & INSTALL $\frac{3}{4}$ " CHECK VALVE IN THE EXISTING SERVICE LINE OF LEONARD E. LADD.





CONNECTION FROM WALDEN RIDGE (TO J. LON FOUST HWY (STATE ROAD 29))

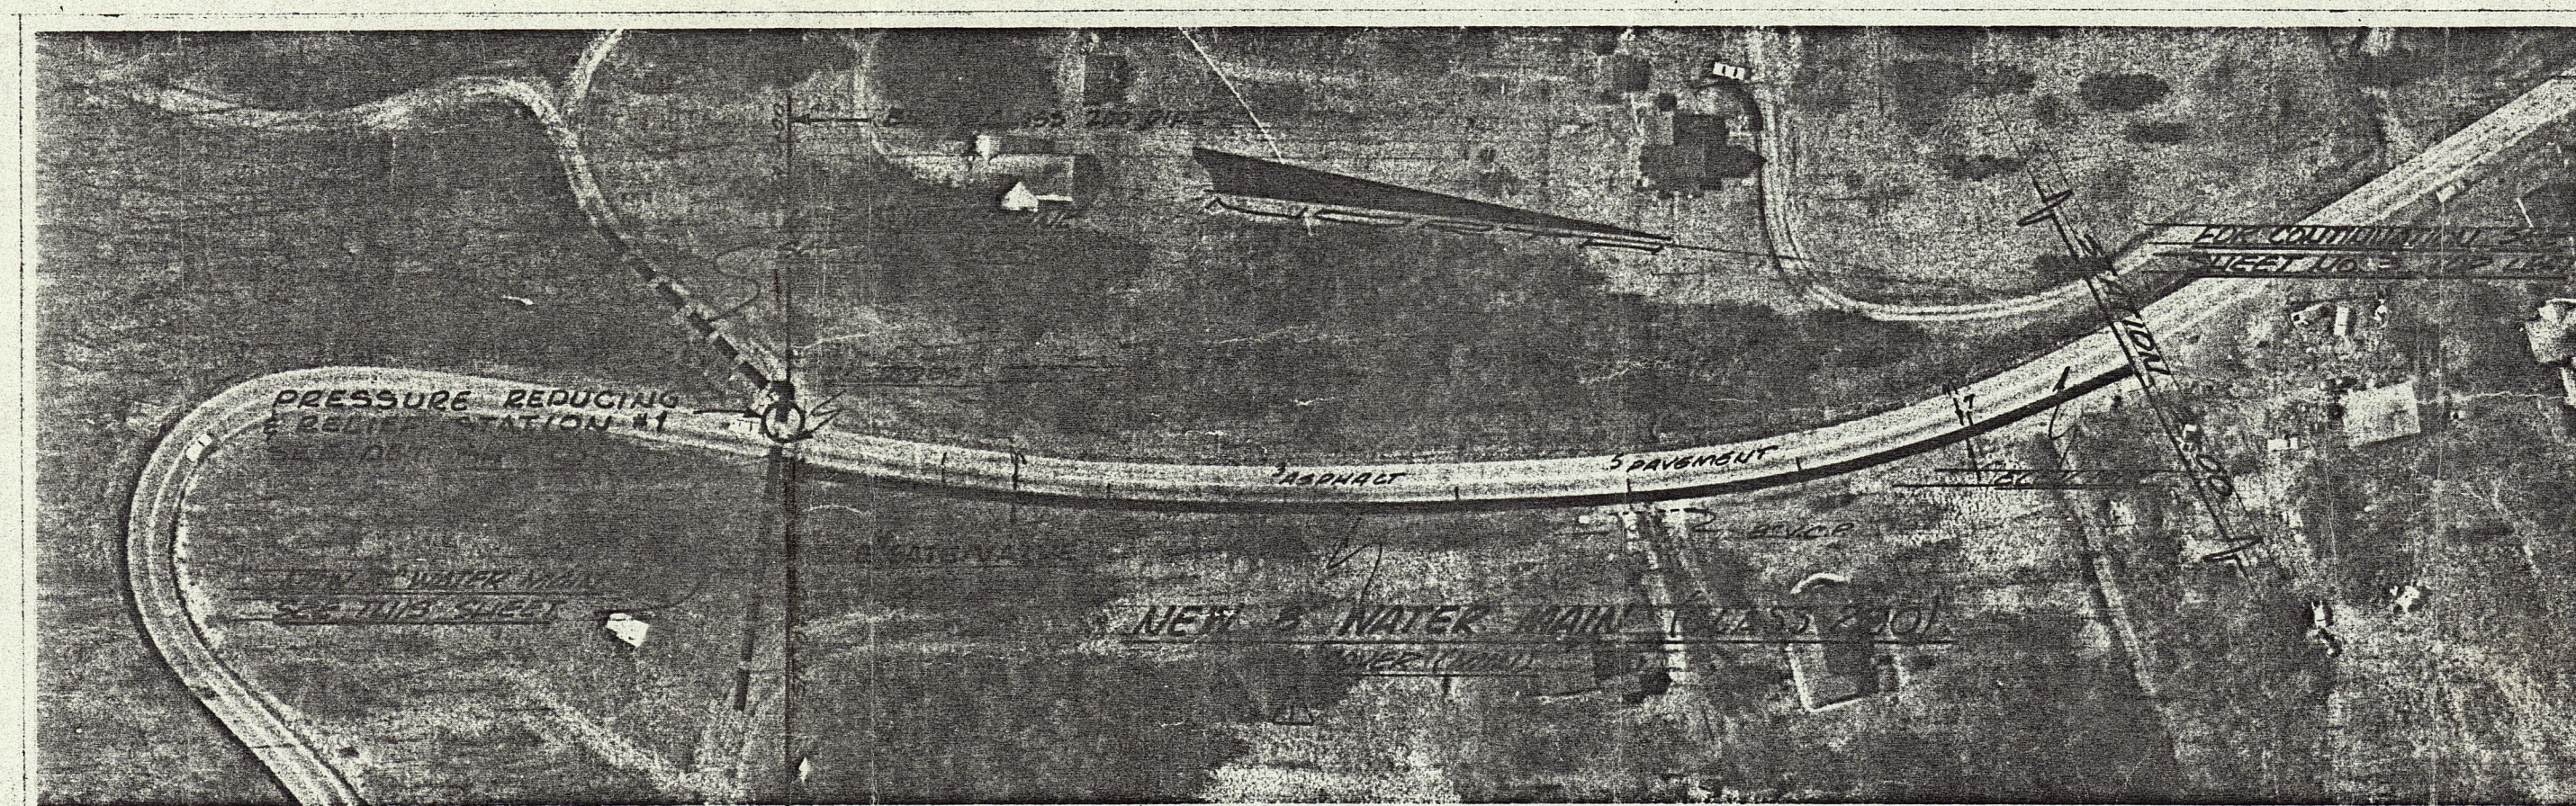








J. LON FOUST HWY. (STATE ROAD 29)

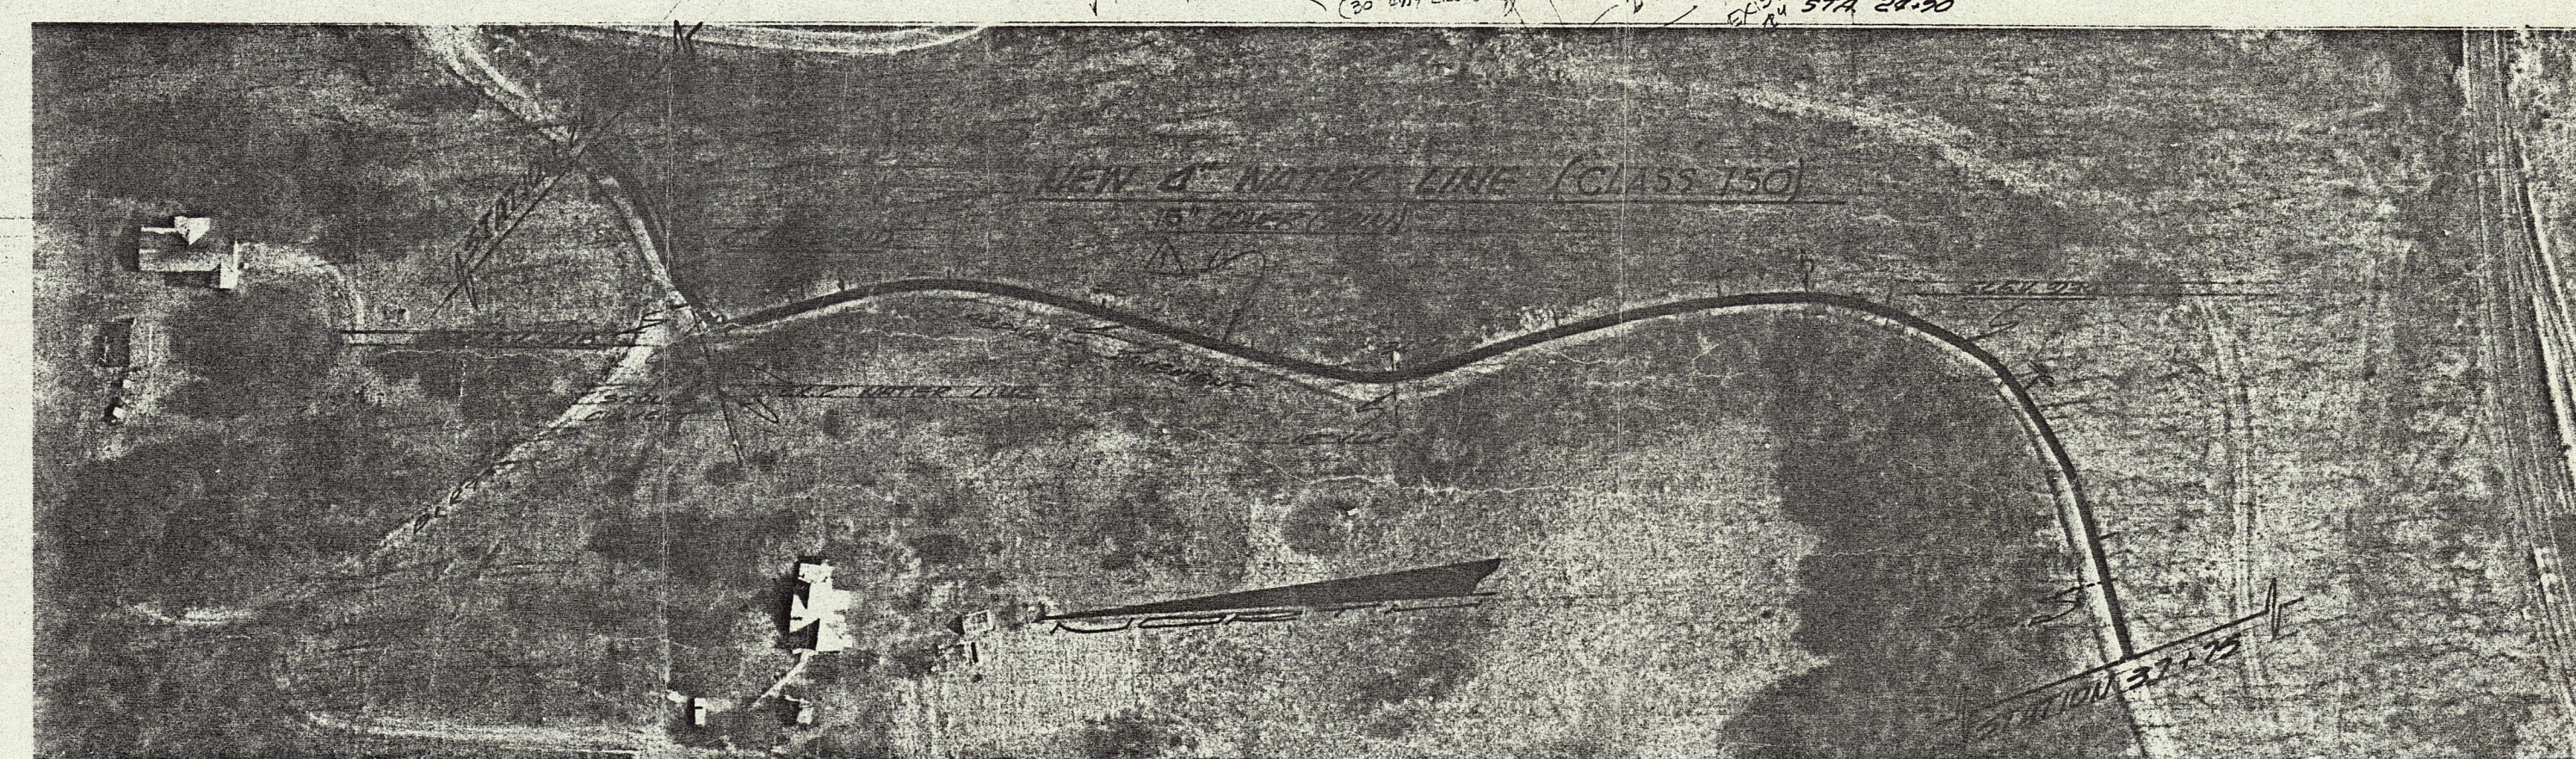


HARRIMAN JUNCTION ROAD

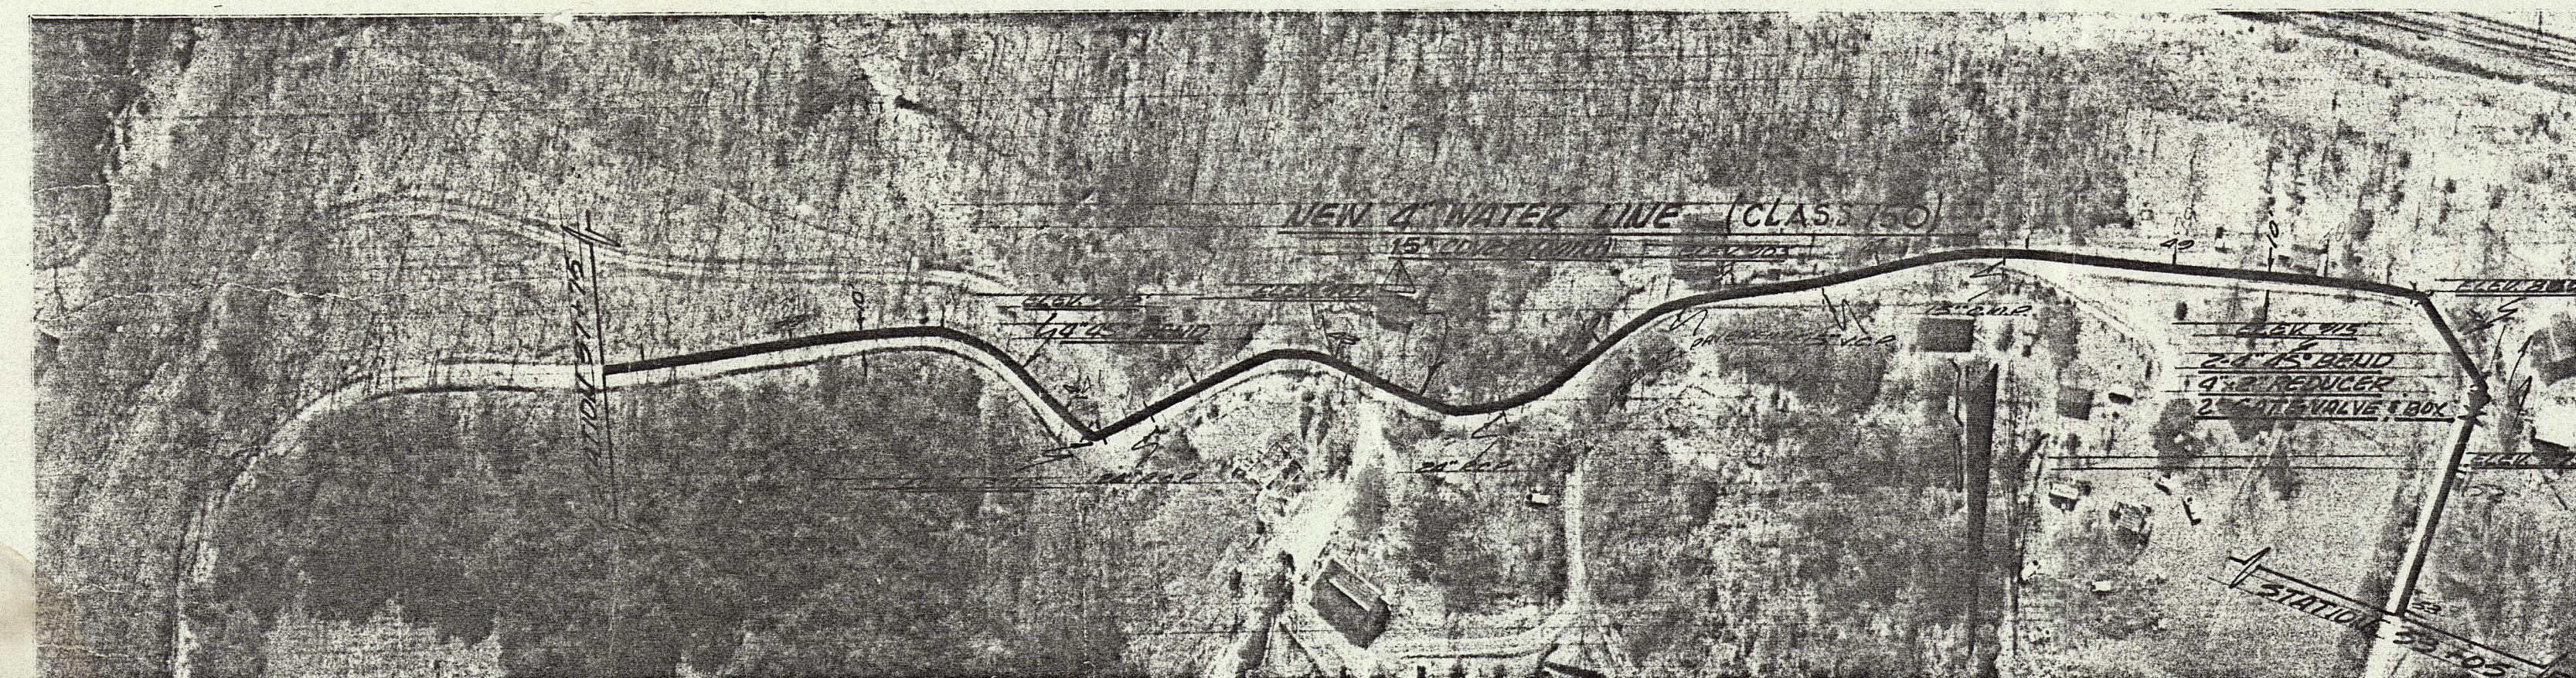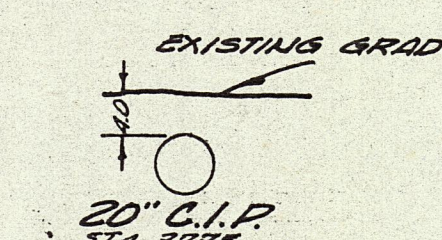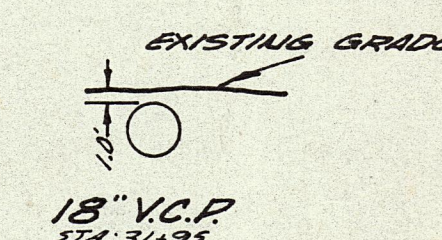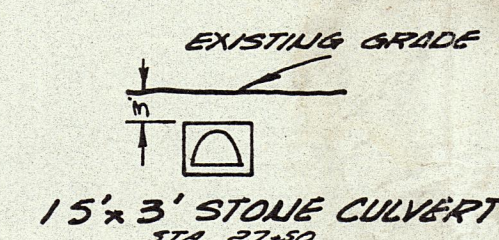

HARRIMAN JUNCTION ROAD

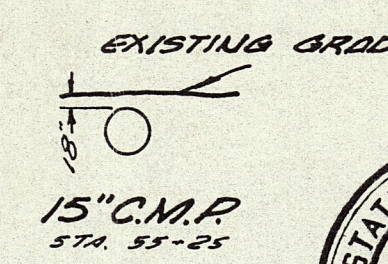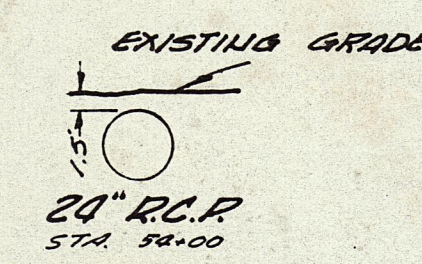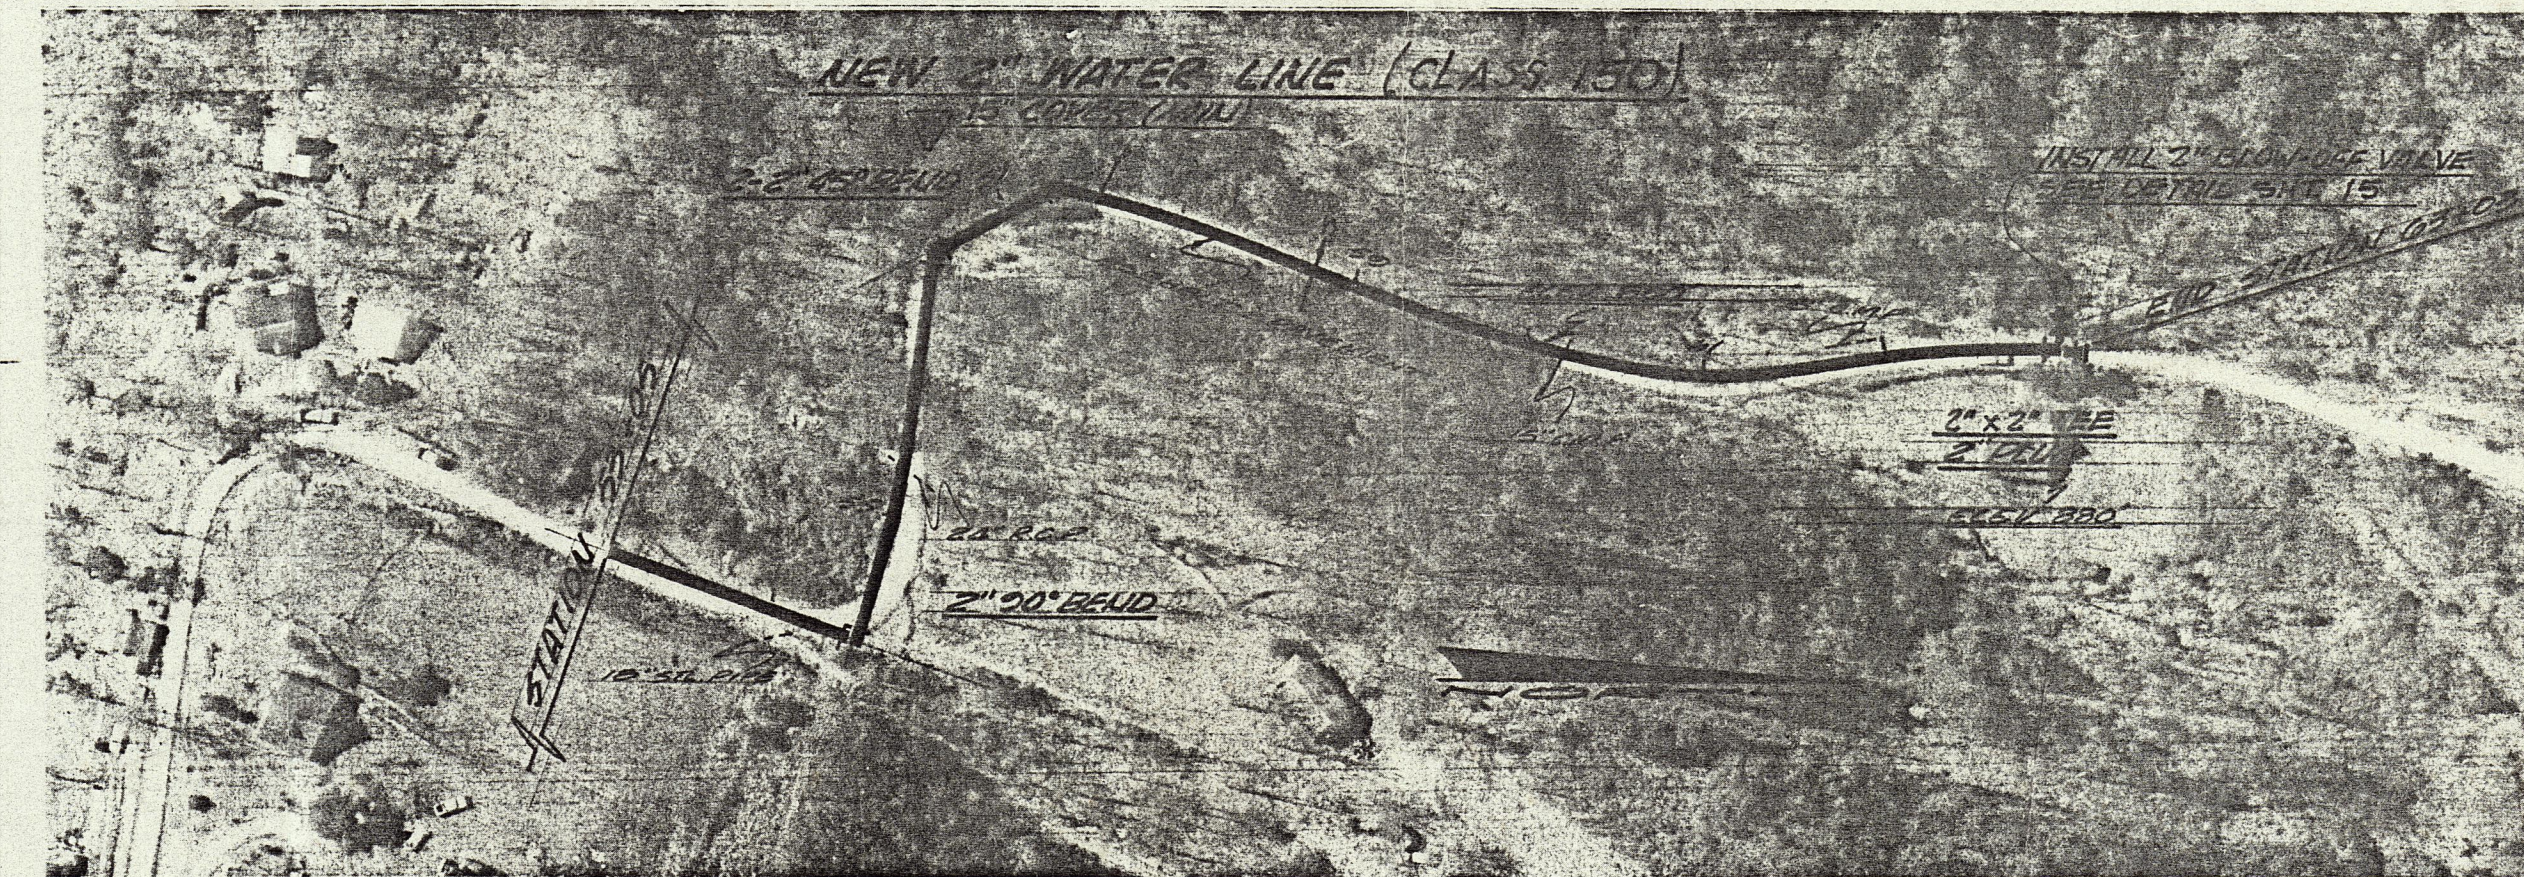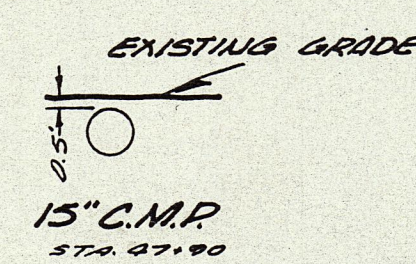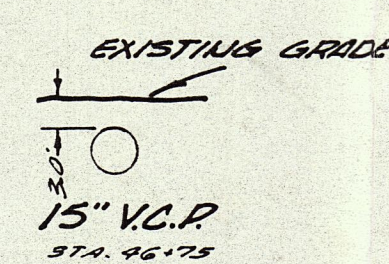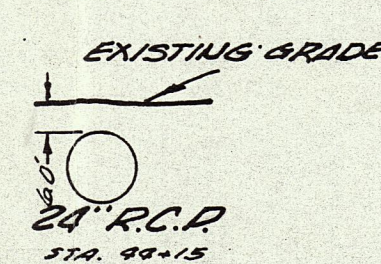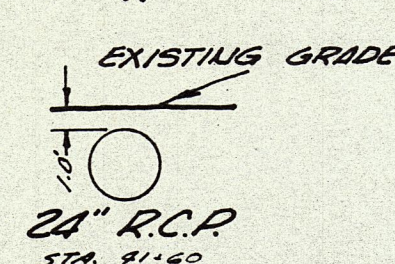

NOTE: OPEN DITCH MUST BE A MINIMUM OF 3 FEET FROM EDGE OF PAVEMENT.

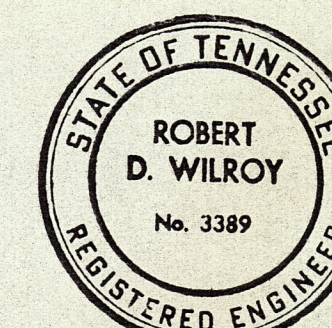

WATER SYSTEM IMPROVEMENTS FOR WOLFE BRANCH UTILITY DISTRICT			
MORRIS & ROANE CO'S. TENNESSEE			
BLACK, CROW AND EIDNESS, INC. ENGINEERS			
GAINESVILLE, FLORIDA		DATE: OCT. 1968	
DRAWN BY: R.M.		FILE NO. 100-68-1	
CHECKED BY: R.M.		SCALE: 1" = 100'	
NEW 8" WATER MAIN ALONG J. LON FOUST HWY. & NEW 8" & 4" WATER LINES ALONG HARRIMAN JUNCTION ROAD			SHEET NO. 2

NO.	REVISIONS	DATE
1	REVISED MIN. COVER	3/12/69

