


PROJECT Gas: DD923-0010

Continued From Page \_\_\_\_\_

# Ridgeview Circle OFF MARGRAVE ST.

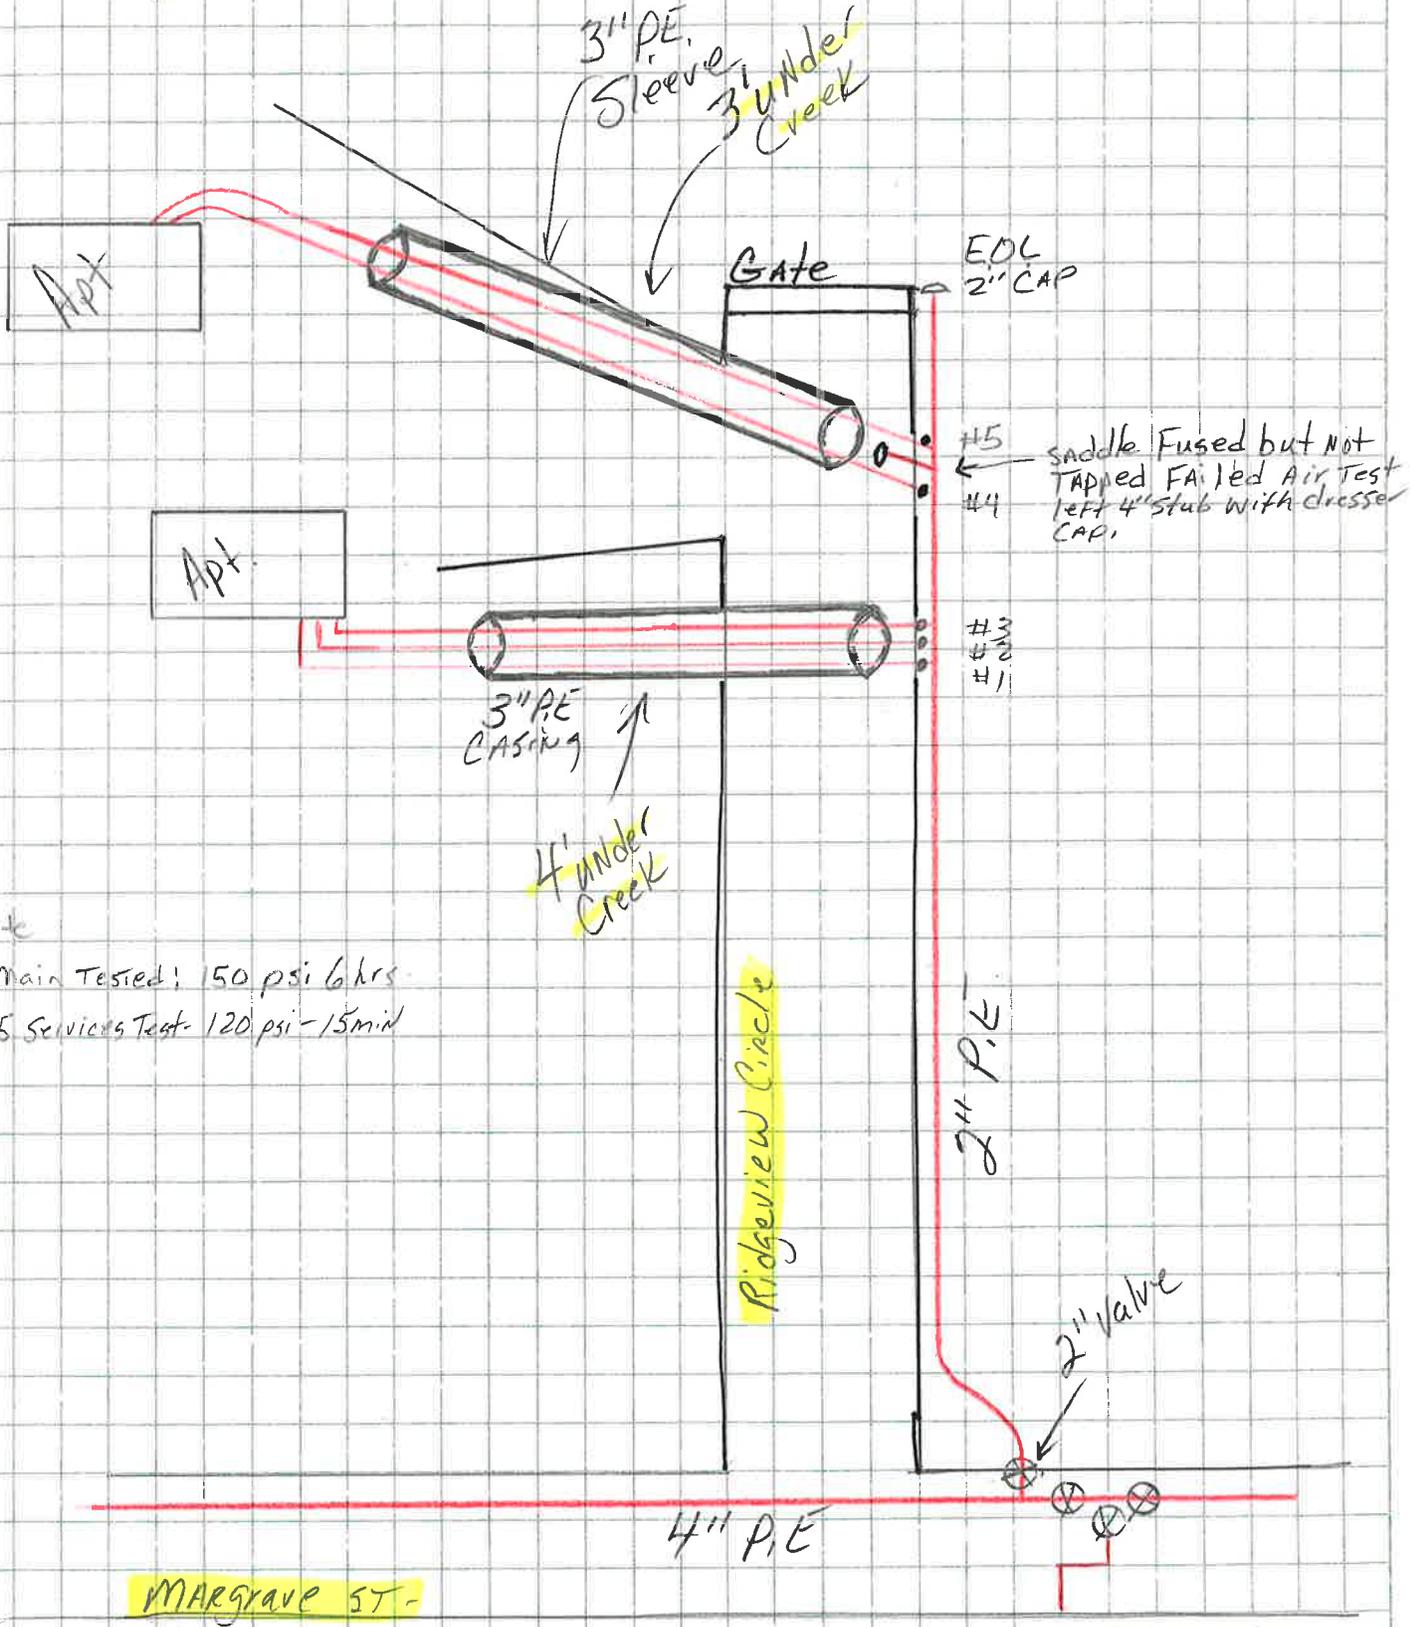

**\* Note**

x Main Tested: 150 psi 6 hrs

x 5 Services Test: 120 psi - 15 min

Continued on Page \_\_\_\_\_

Read and Understood By \_\_\_\_\_

*Frankie Davis* 7/27/2020

Signed

Date

Signed

Date