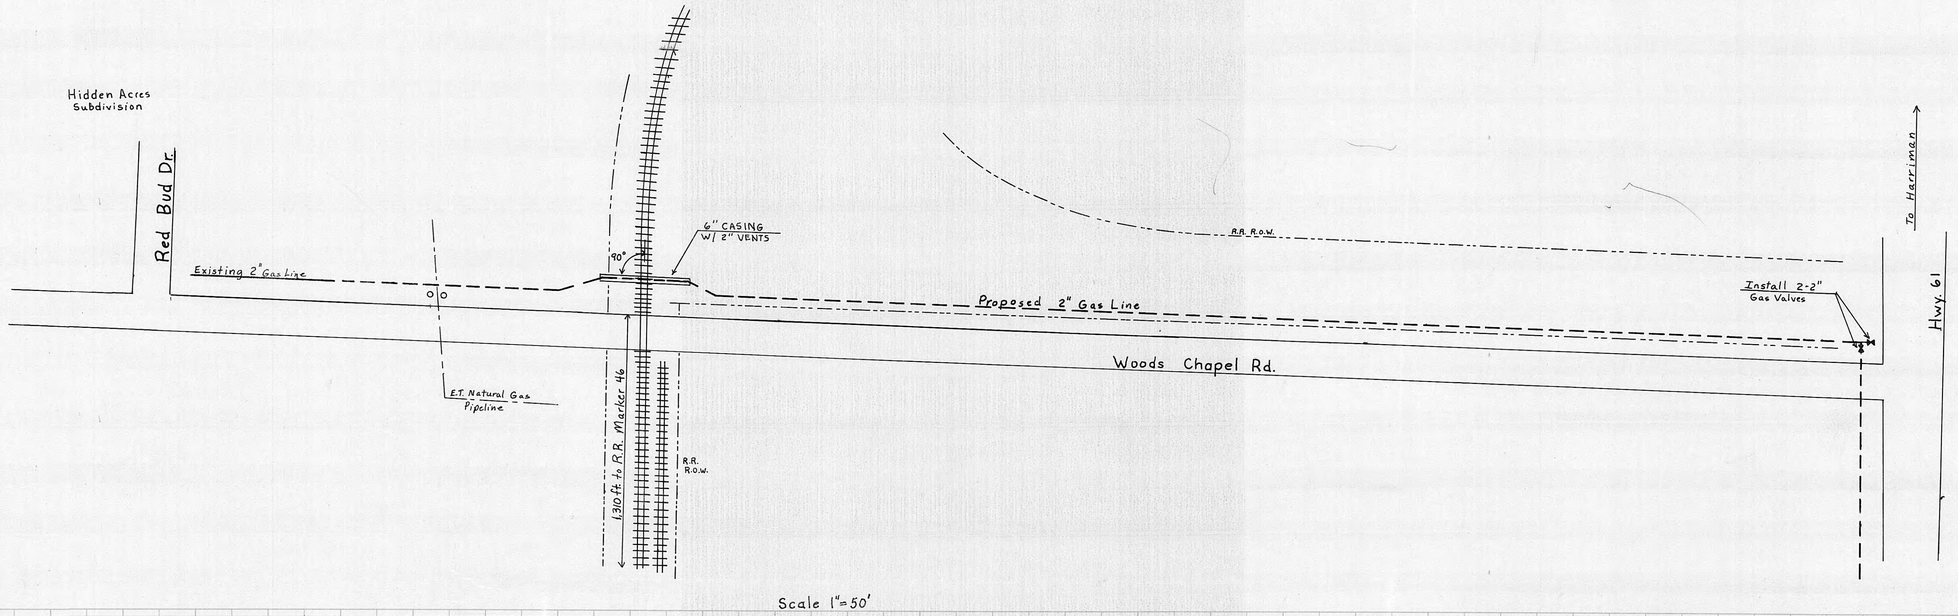

Scale 1"=50'

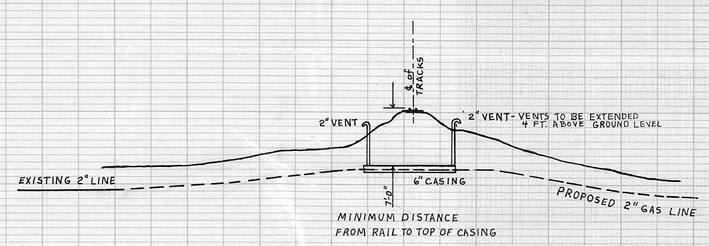

MINIMUM DISTANCE FROM RAIL TO TOP OF CASING

	CARRIER PIPE	CASING PIPE
CONTENTS TO BE HANDLED	NATURAL GAS	CARRIER
OUTSIDE DIAMETER	2.375	6"
PIPE MATERIAL	PE	STEEL
SPECIFICATION AND GRADE	2406 SDR11	ASTM 53 B
WALL THICKNESS	0.216"	0.188"
ACTUAL WORKING PRESSURE	45 PSI	N/A
TYPE OF JOINT	FUSSION	WELDED
COATING	NONE	NONE
METHOD OF INSTALLATION	SLIDE	JACK & BORE
CATHODIC PROTECTION	YES( ) NO(X)	YES( ) NO(X)
BURY: Base of Rail to top of Casing	7 Ft.	0 In.
BURY: (Not beneath tracks)	4 Ft.	0 In.
BURY: (ROADWAY DITCHES)	4 Ft.	0 In.

HARRIMAN UTILITY BOARD
300 ROANE STREET
HARRIMAN, TENNESSEE

PROPOSED GAS LINE CONSTRUCTION
WOODS CHAPEL RD.

DATE: 8/13/97
DRAWN BY: RB

~~G-249-S~~
G-258-S

PLAN
SURVEYED: BY
PLOTTED:
NOTE BOOK ALIGNMENT CHECKED
RT. OF WAY CHECKED
No.
DATE

PROFILE
SURVEYED:
PLOTTED:
NOTE BOOK GRADES CHECKED
B.M.'s NOTED
STRUCTURES & STATIONING CHECKED
No.

Keuffel & Esser Company