
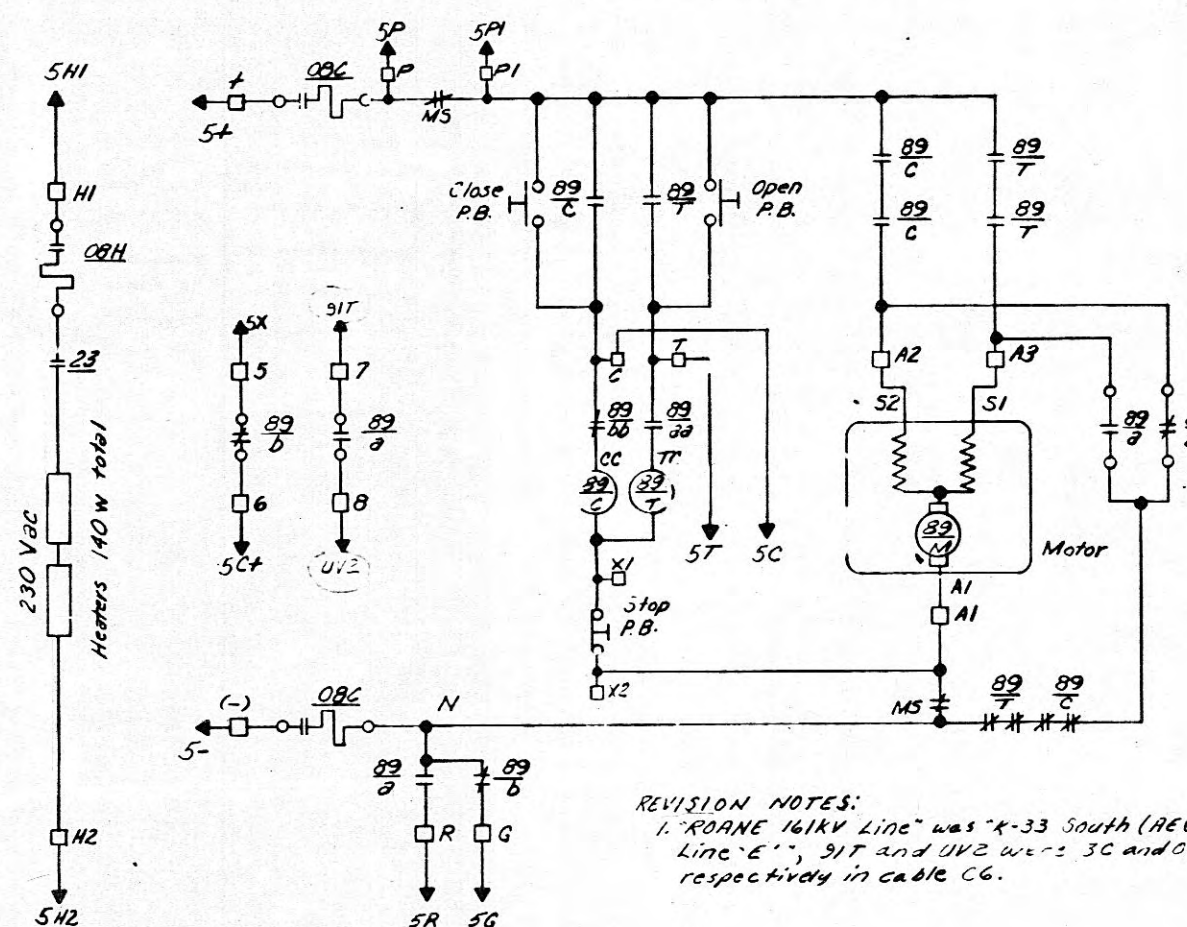



EOL5-HM

MECHANISM HOUSING (F.V.)

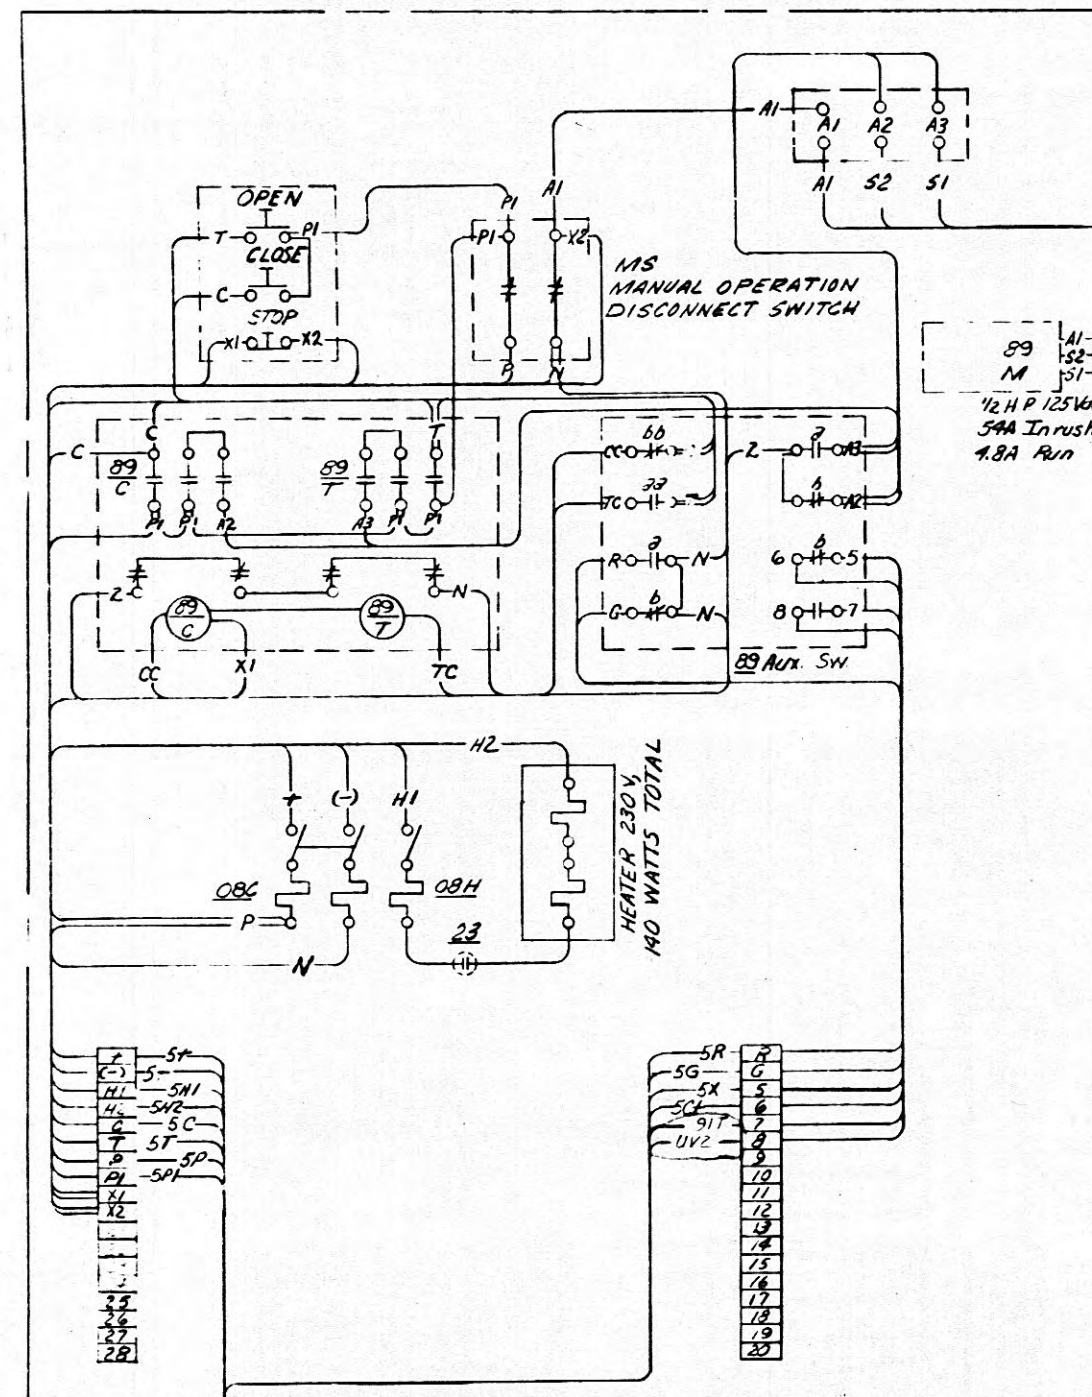

REVISION NOTES:
1. RUANE 161KV Line was "K-33 South (REC)
Line "E"; 91T and 91V2 were SC and 91V2
respectively in cable C6.

89-1 Aux Sw. (MTD ON OPER. PIPE)

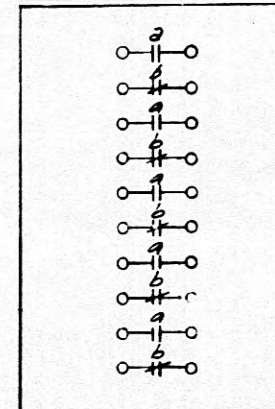

REFERENCES:
Three Line Diagram WL-3365
Elementary Diagram WL-2266
Mfr's Drawings XA-2390
Mfr's Wtr Diagram 310-927

REV.	DATE	BY	CHKD.	APP.	REMARKS
1	3/23/67	WEN	SS	W.A. 35687	See Revision Note 1
2	9-27-71	RLR	W.A. 35687		
3		JRD			

FORNE 161KV LINE		9599	959	XA-2990
LOCATION	DEVICE NO.	SERIAL NO.	WAB NO.	FILE
TENNESSEE VALLEY AUTHORITY DIVISION OF POWER PLANNING AND ENGINEERING HARRIMAN, TENN. SUBSTATION-161KV CONTR. ELEM. DIAG. FOR ITE "TR-A-49" 161KV/1600A, MOD SWITCH WITH "MO-10" MOTOR MECH.				
DATE	DESIGNED BY	CHECKED BY	APPROVED BY	SHEET 1 OF 1
9-27-71	W.A. 35687	W.A. 35687	W.A. 35687	WH-5703
SCALE	CLASS CODE			R-1

MICROFILMED