



- (1) HYDRANT SHALL CONFORM TO THE LATEST REQUIREMENTS OF ANWPA STANDARD C-502.
- (2) HYDRANT SHALL BE EQUIPPED WITH TWO 2-L/2-INCH HOSE OUTLET NOZZLES AND ONE 4-L/2-INCH PUMPER OUTLET NOZZLE.
- (3) NOZZLE THREAD SHALL CONFORM WITH NFPA NO. 194 FOR NATIONAL STANDARD FIRE HOSE COUPLING SCREW THREADS.
- (4) SIZE OF HYDRANT MAIN VALVE SHALL BE 5-1/4-INCH NOMINAL DIAMETER.
- (5) SIZE OF HYDRANT INLET SHALL BE 6-INCH MJ WITH ONE SET OF MJ ACCESSORIES.
- (6) OPERATING NUT SHALL OPEN COUNTERCLOCKWISE.
- (7) THE OPERATING NUT SHALL BE PENTAGONAL IN SHAPE. THE NUT SHALL NOT BE LESS THAN ONE-INCH IN HEIGHT, MEASURING 1-1/2-INCHES FROM POINT TO FLAT AT THE BASE OF THE NUT AND 1-7/16-INCHES AT THE TOP.
- (8) COLOR OF THE FINISH PAINT ABOVE THE GROUND LINE SHALL BE OSHA YELLOW.
- (9) HYDRANT SHALL BE EQUIPPED WITH HARNESSING LUGS.
- (10) OUTLET NOZZLE-CAP CHAINS ARE REQUIRED.
- (11) DEPTH OF BURY TO BE 42 INCHES (FROM GROUND LINE TO BOTTOM OF PIPE).
- (12) HYDRANT SHALL BE AMERICAN CAST IRON PIPE COMPANY, AMERICAN-PARLING, CATALOG NO. B-B4-B, M & H VALVE CO. NO. 929, MUELLER COMPANY, CO. CENTURION, CATALOG NO. A-413.

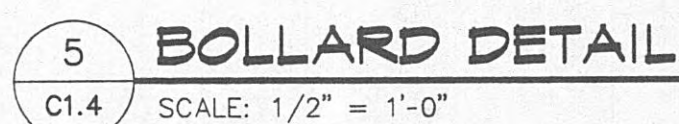

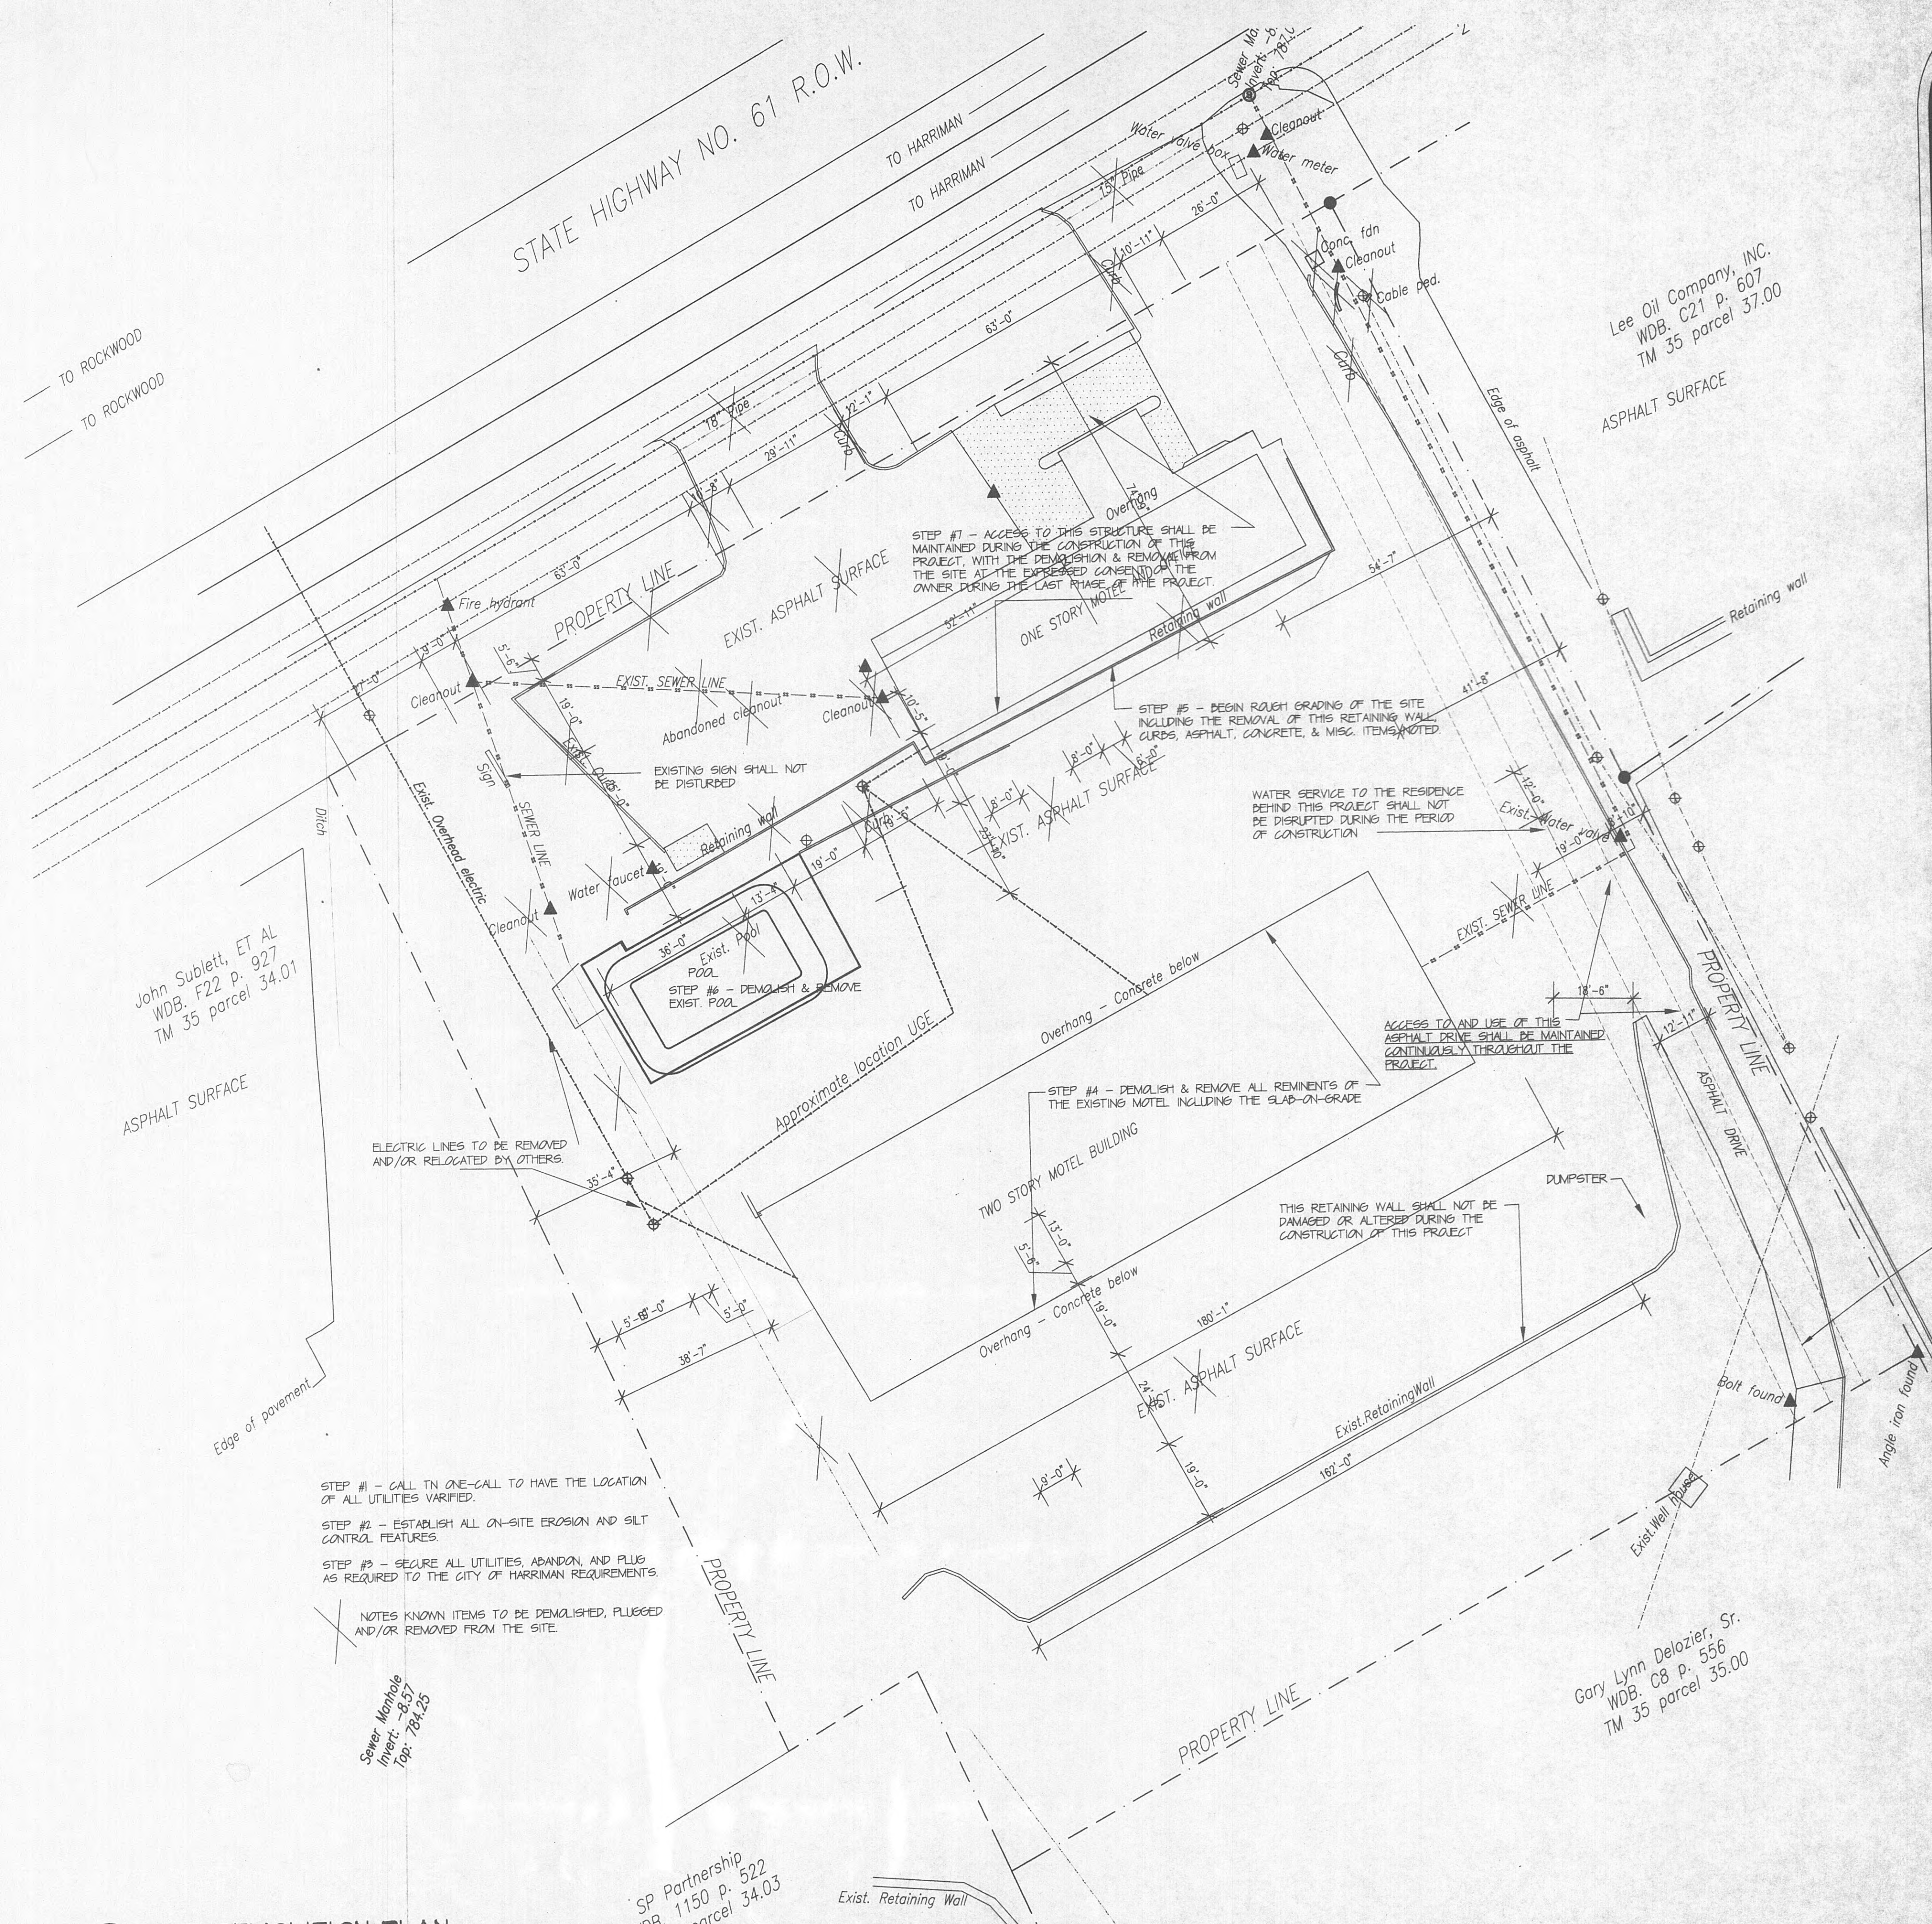

John Sublett, ET AL
WDB. F22 p. 927
TM 35 parcel 34.01

Lee Oil Company, INC.
WDB. C21 p. 607
TM 35 parcel 37.00

Gary Lynn Delozier, Sr.
WDB. C8 p. 556
TM 35 parcel 35.00

SP Partnership
WDB. 1150 p. 522
TM 35 parcel 34.03

- STEP #1 - CALL TN ONE-CALL TO HAVE THE LOCATION OF ALL UTILITIES VERIFIED.
 - STEP #2 - ESTABLISH ALL ON-SITE EROSION AND SILT CONTROL FEATURES.
 - STEP #3 - SECURE ALL UTILITIES, ABANDON, AND PLUG AS REQUIRED TO THE CITY OF HARRIMAN REQUIREMENTS.
- NOTES KNOWN ITEMS TO BE DEMOLISHED, PLUGGED AND/OR REMOVED FROM THE SITE.

Best & Associates Architects

1726 W LAMAR ALEX PKY, HARRIMAN, TN 37001
PHONE 855-977-1650 FAX 855-981-1678

SUPER 8 HOTEL HARRIMAN, TN

REVISIONS

NO.	DESCRIPTION
0	

DRAWN BY PW
CHECKED BY EP
DATE 07-18-08
SCALE: 1" = 20'-0"
DESCRIPTION SITE DEMOLITION PLAN

SHEET
C1.1
OF

1. THE CONTRACTOR IS REQUIRED TO PLACE A TENNESSEE-ONE-CALL PRIOR TO BEGINNING CONSTRUCTION. TN-1-CALL TICKET NUMBER MUST BE KEPT KNOWN BY ALL EXCAVATION OPERATORS.
2. CITY OF CLINTON DISTENSION CERTIFICATION REQUIRED BEFORE FINAL CERTIFICATE OF OCCUPANCY APPROVAL.
3. THE CONTRACTOR SHALL FOLLOW THE CITY OF HARRIMAN STREET & DRAINAGE CONSTRUCTION SPECIFICATIONS, LATEST EDITION IF THE WORK IS WITHIN THE CITY RIGHT OF WAY OR TO BE INCORPORATED INTO THE PUBLIC SYSTEM.
4. STAKE OUT ROAD, BUILDING, AND PARKING AREAS PRIOR TO GRADING.
5. CONTRACTOR TO REVIEW SITE AND BECOME FAMILIAR WITH DETAILS PRIOR TO CONSTRUCTION.
6. DIMENSIONS ALWAYS ARE TO FACES OF CURBS, FACES OF BUILDINGS, FACES OF WALLS, AND BACK OF SIDEWALKS TYPICAL UNLESS OTHERWISE NOTED.
7. ALL CURB RADI 50' UNLESS OTHERWISE NOTED.
8. ALL CURD IRONS MUST READ "DUMP NO WASTE, DRAINS TO STREAM"
9. ALL NON PAVED AREAS WILL BE EITHER GRASSED OR MULCHED TO PREVENT EROSION.
10. PRECONSTRUCTION GROUND COVER SHALL NOT BE DISTURBED MORE THAN 20 CALENDAR DAYS PRIOR TO GRADING OR EARTH MOVING UNLESS THE AREA IS SEEDED AND/OR MULCHED OR OTHER TEMPORARY GROUND COVER IS INSTALLED.
11. STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS PRACTICABLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED, BUT IN NO CASE MORE THAN SEVEN DAYS AFTER CONSTRUCTION ACTIVITY IN THAT PORTION OF THE SITE HAS TEMPORARILY OR PERMANENTLY CEASED. EXCEPT IN THE FOLLOWING SITUATION: WHERE CONSTRUCTION ACTIVITY ON A PORTION OF THE SITE IS TEMPORARILY CEASED, AND EARTH DISTURBING ACTIVITIES WILL BE RESUMED WITHIN 15 DAYS, TEMPORARY STABILIZATION MEASURES DO NOT HAVE TO BE INITIATED ON THAT PORTION OF THE SITE.
12. THE SITE CONTAINS 1 BUILDING A 3 STORY NEW HOTEL
13. PARKING SPACES ARE 65 SPACES PLUS 4 HANDICAPPED
CALCULATED AS FOLLOWS:
1 PER SUITE (60) = 60
TOTAL REQUIRED = 63
TOTAL PROVIDED = 69
- PARKING SPACES ARE $9' \times 19' - 0" = 171 \text{ SF}$
HANDICAPPED SPACE $14' \times 19' = 266 \text{ SF}$
14. THE BUILDING IS RESIDENTIAL OCCUPANCY
15. THE PROPERTY IS 1.84 ACRES AND THE AMOUNT COVERED BY THE BUILDING AND PARKING IS .117 ACRES (.1124%).
16. THE PROPERTY IS CURRENTLY ZONED "B-4".
17. THE BUILDING SET BACKS ARE: FRONT-50', REAR-20', SIDE-20'.
18. GARBAGE WILL BE HANDLED WITH DUMPSSTER UNIT
19. LANDSCAPING WILL COMPLY WITH ALL ASPECTS OF THE CITY OF HARRIMAN REQUIREMENTS.
20. TEMPORARY SEEDING IS REQUIRED WHEN GRADING OPERATIONS ARE TEMPORARILY HALTED FOR OVER 14 DAYS, AND ON SOIL STOCKPILED. PERMANENT SEEDING IS REQUIRED WHEN GRADING OPERATIONS ARE COMPLETED AND/OR CONSTRUCTION OPERATIONS WILL NOT IMPACT THE DISTURBED AREA. SEED AREAS THAT SHOW SIGNS OF EROSION.

1'-0"

1'-6"

HANDICAPPED PARKING SPACE SIGN
12" X 18" MEETING ADA REQUIREMENTS

5" X 1 1/2" STL BREAKAWAY CHANNEL
POST ATTACH POSTS W/ 3/8" DIA. GALV. BOLTS, NUTS,
& WASHERS

LINE OF SIDEWALK - MOUNT SIGN
6" BEHIND FACE OF CONCRETE

12" DIA. CONG.
BASE

1'-0"

3'-0"

[illegible]

Diagram illustrating the cross-section of a road shoulder and curb area, showing the following layers and dimensions:

- 1 1/2" BITUMINOUS WEARING COURSE
- 3" BITUMINOUS BINDER COURSE
- 6" SUBBASE ON COMPACTED SOIL
- GRASS OR LANDSCAPING
- 4" MIN. TOP SOIL
- 12" MIN GRAVEL BEHIND CURB
- UNDISTURBED OR COMPACTED SOIL

Dimensions:

- 6"
- 1'-0"
- 5'-0"
- 5'-0"

1 1/2" BITUMINOUS WEARING COURSE

3" BITUMINOUS BINDER COURSE

6" SUBBASE ON COMPACTED SOIL

1/2" EXPANSION JOINT

4" CONCRETE SIDEWALK
4000 PSI CONCRETE

6x6 10/10 WWF

12" MIN GRAVEL BEHIND CURB

UNDISTURBED OR COMPACTED SOIL

6"

6"

6"

1/2"

6"

5" WIDE SMOOTH
TROWEL FINISH (TYP)

LIGHT BROOM FINISH

EDGE OF WALK

SCORE JOINT OR
EXPANSION JOINT
MIN 5' OC. SEE SITE
PLAN FOR LOCATION

SEE SITE PLAN FOR WIDTH


EXPANSION JOINT

EXPANSION JOINT MAX 20' OC.

6" CURB

N

1 SITE LAYOUT
C1.2 SCALE: 1" = 20'-0"

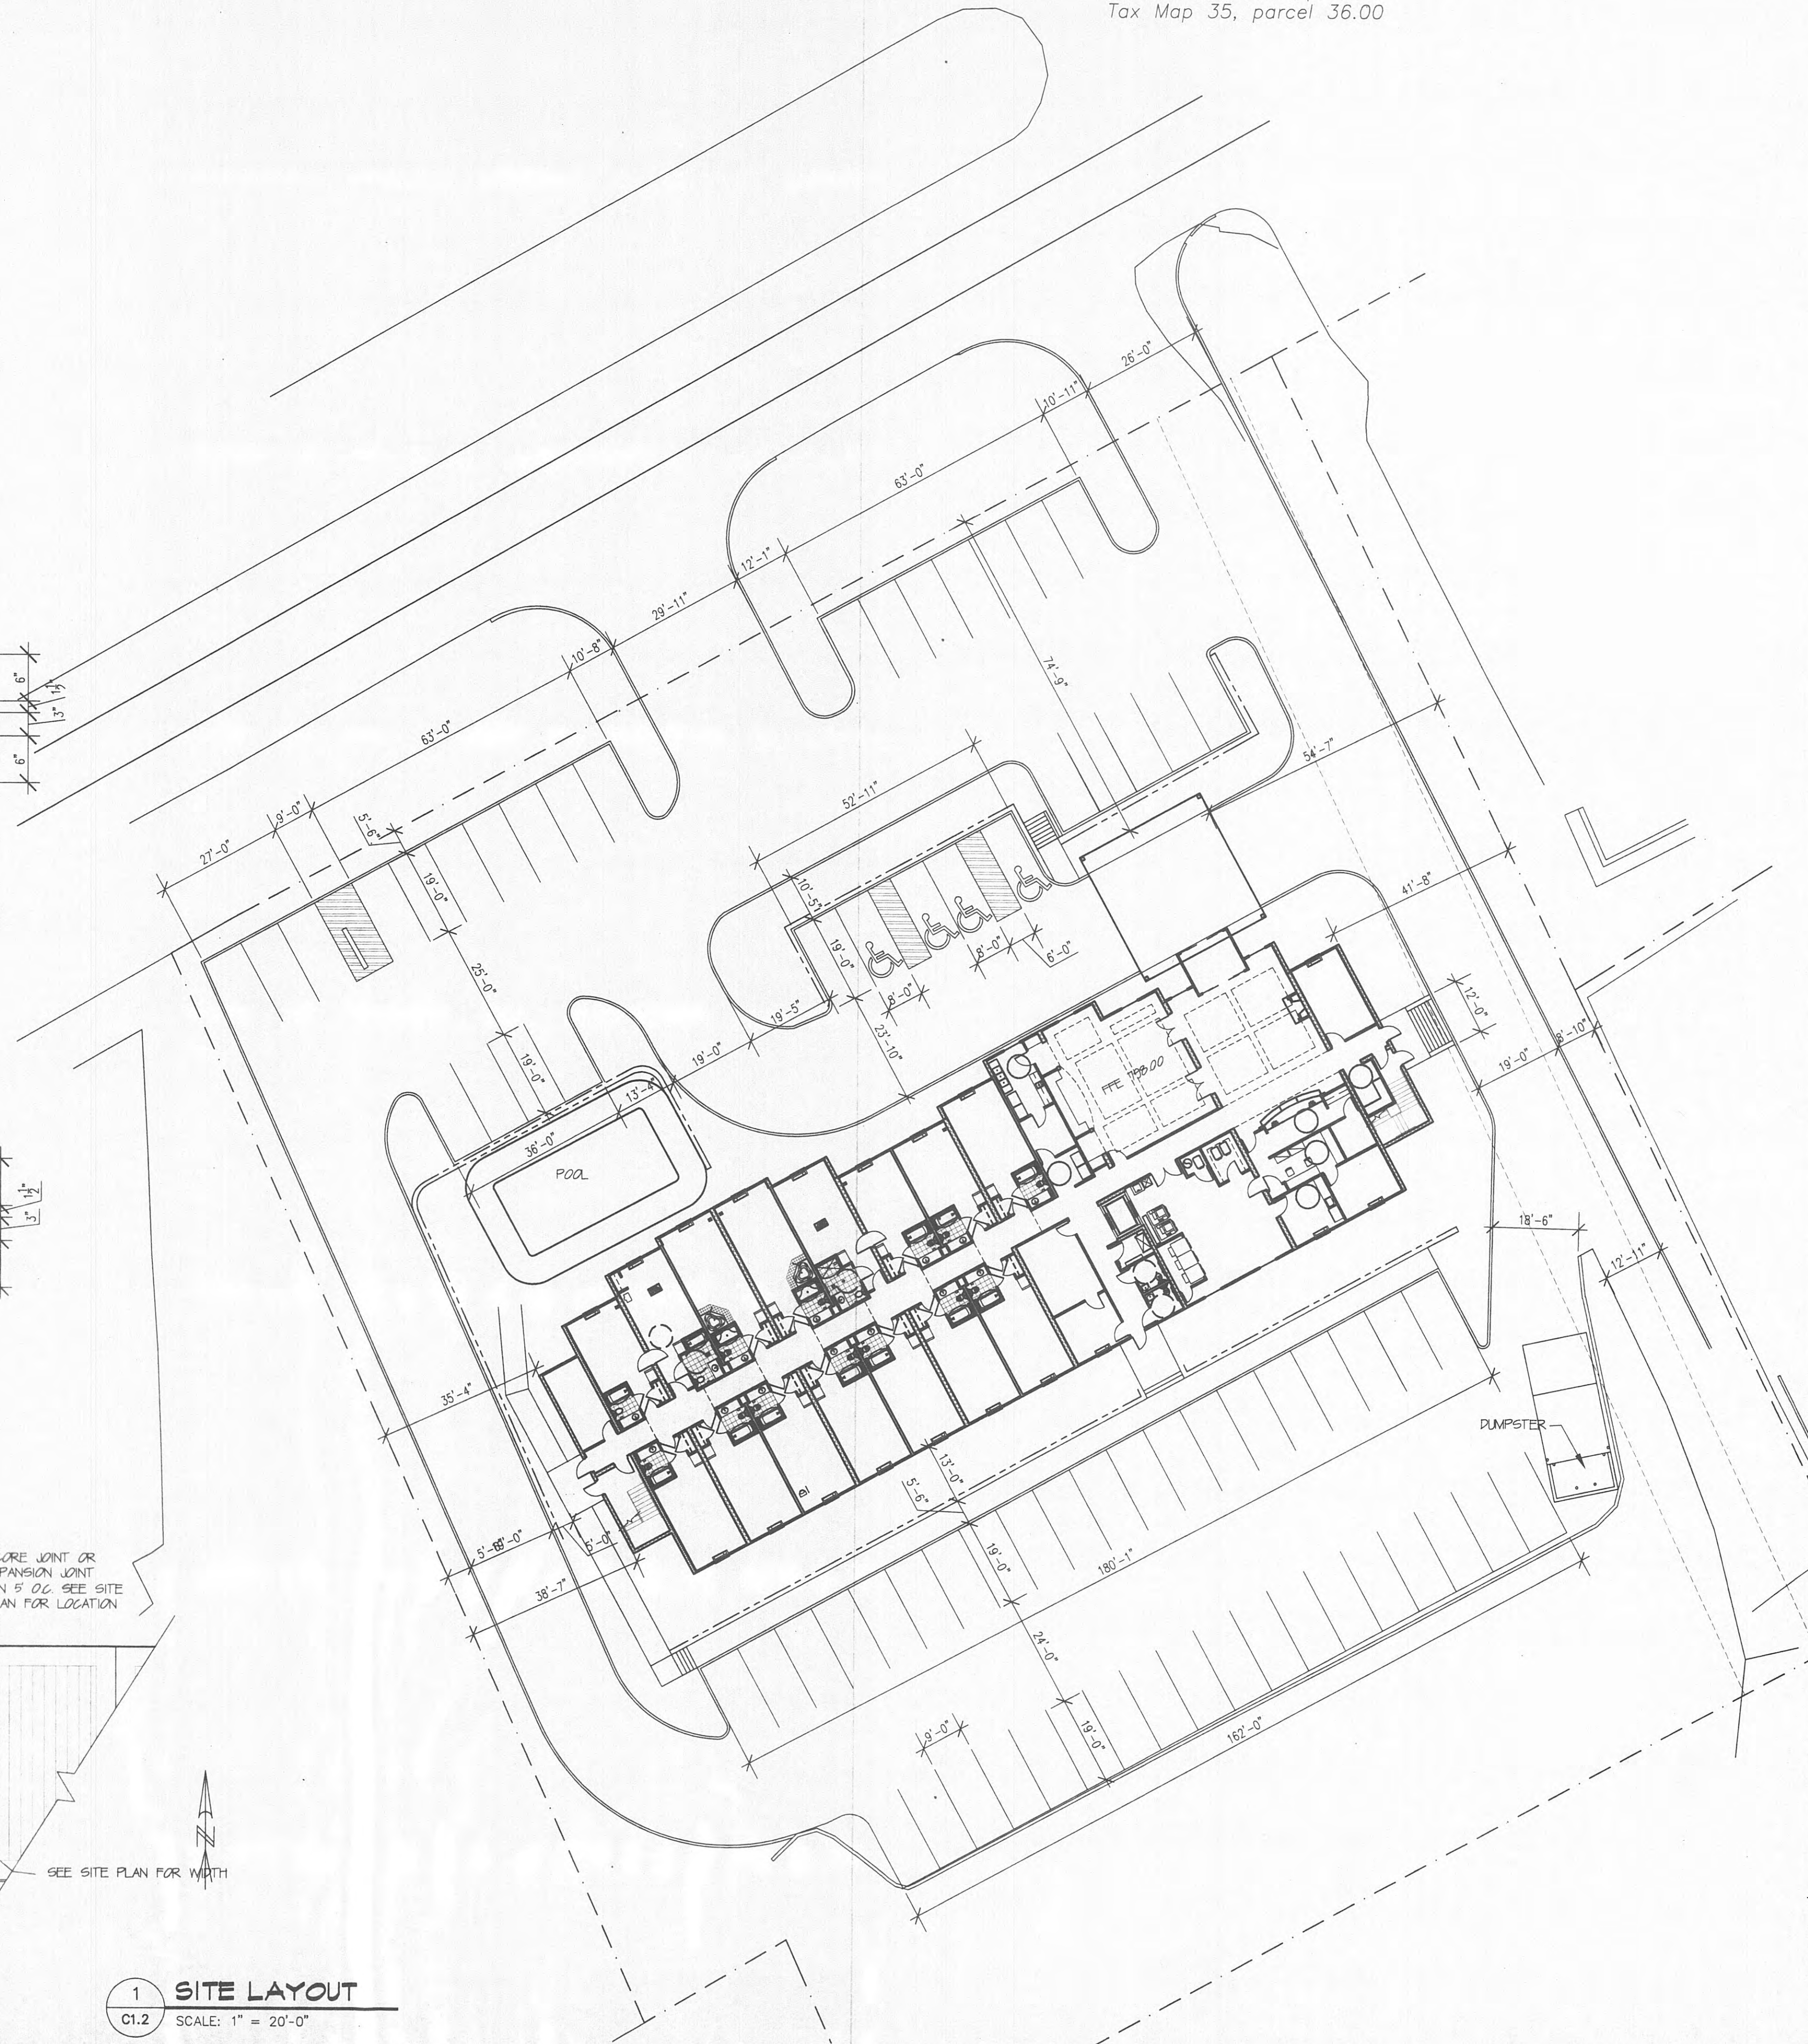

Best & Associates Architects

1726 W LAMAR ALEX PKY, MARYVILLE, TN 37801
PHONE 865-977-1610 FAX 865-981-1678

SUPER 8
HOTEL
HARRIMAN, TN

REVISION _____

DRAWN BY _____ PW
CHECKED BY _____ GB
DATE _____ 03-28-08
SCALE: _____ 2" = 1'-0"
DESCRIPTION _____

SITE LAYOUT PLAN

SHE

C1.2
OF

