
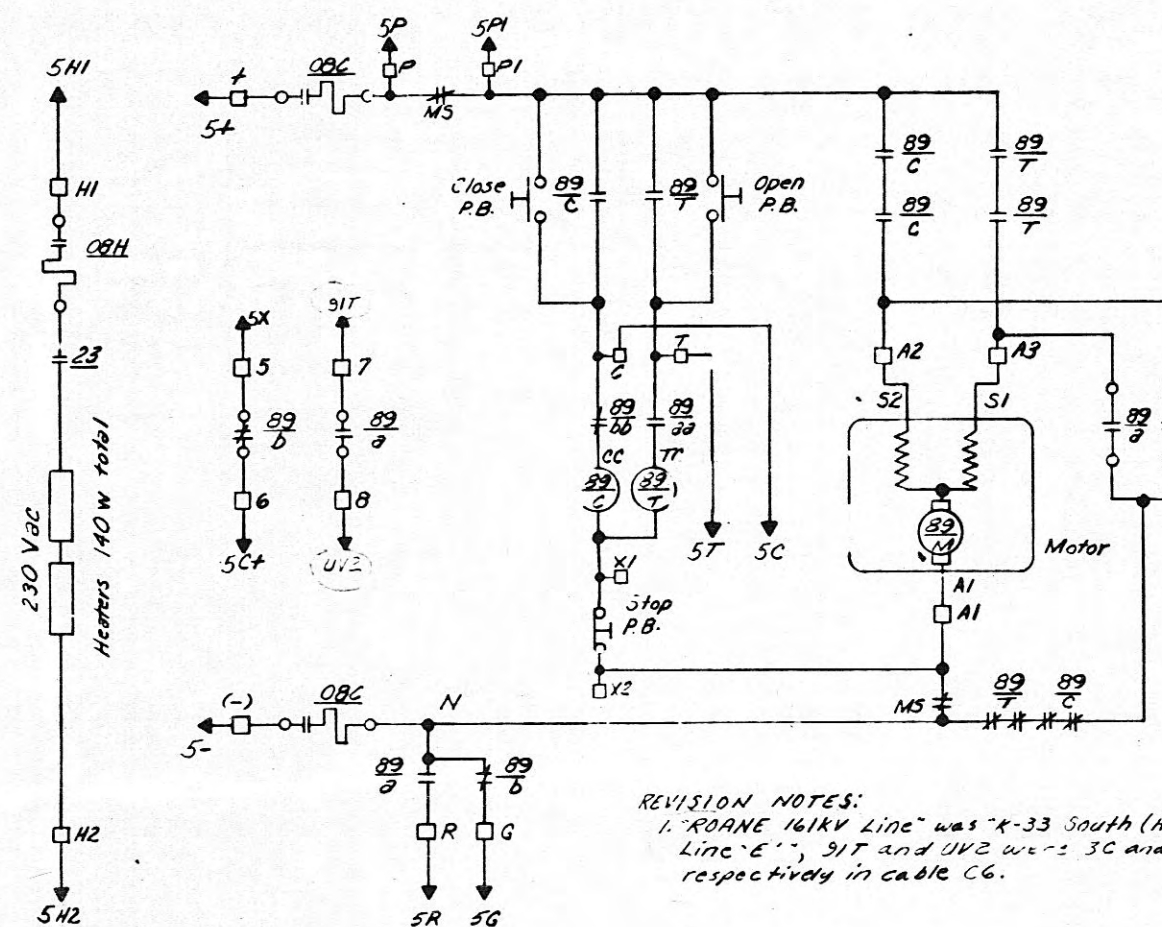



EDLS-HM

MECHANISM HOUSING (F.V.)

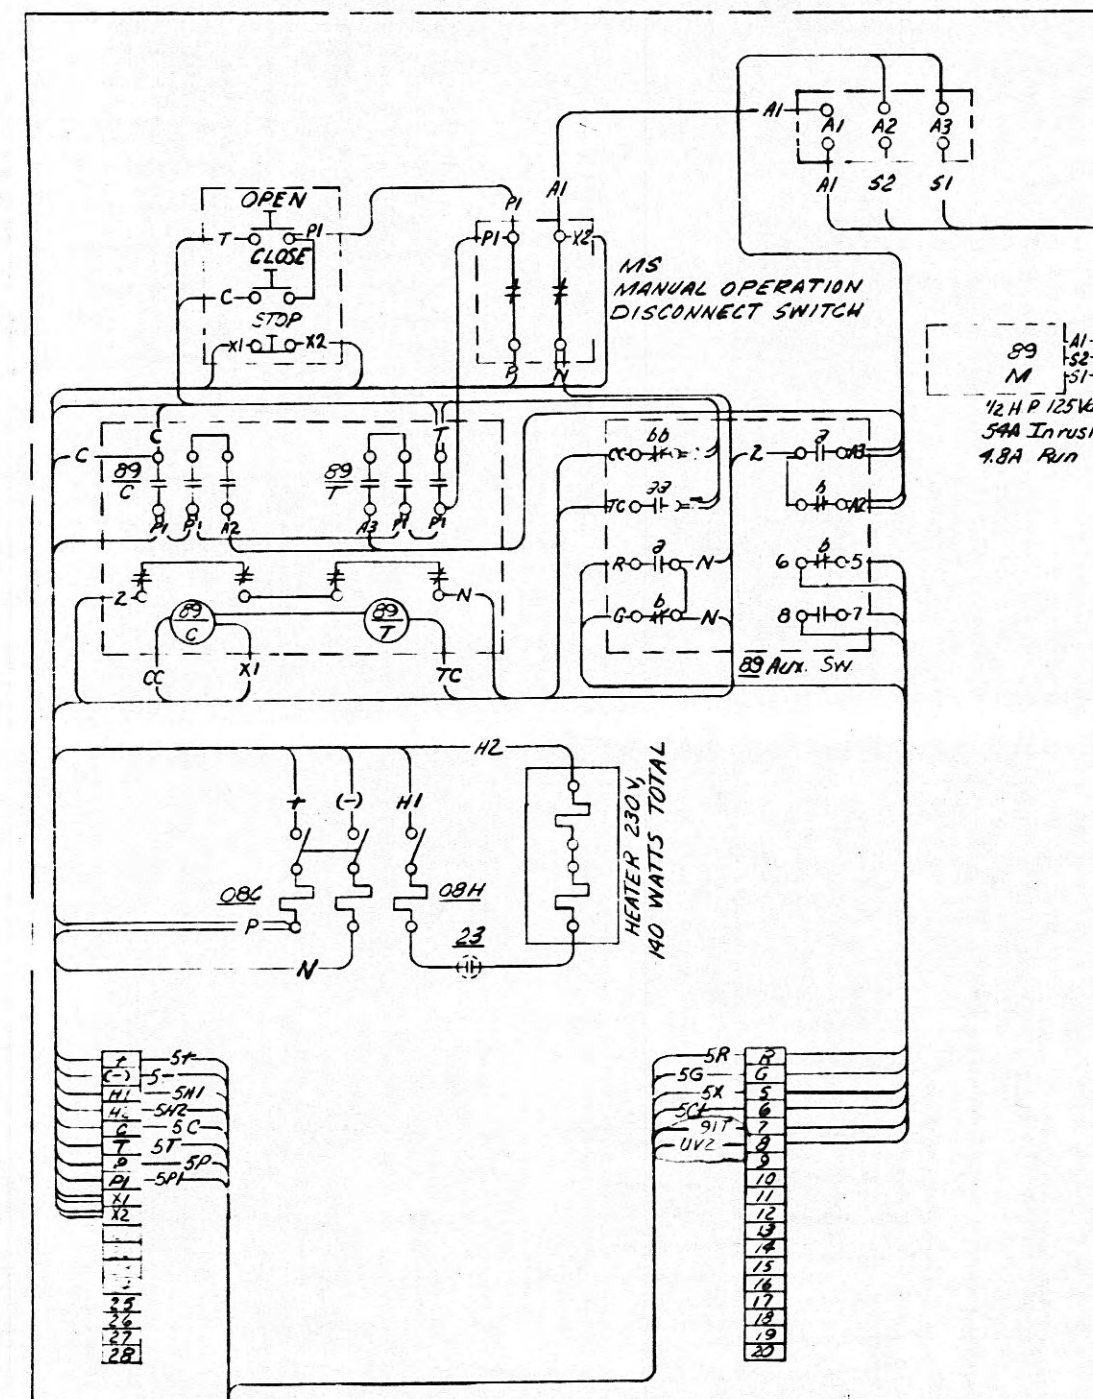

REVISION NOTES:
1. "ROANE 161KV LINE" was "K-33 South (REC)
Line 'E'", 91T and 91Z were 3C and 91Z
respectively in cable C6.

89-1 Aux Sw. (MTD ON OPER. PIPE)

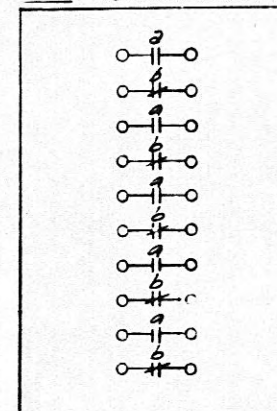

REFERENCES:
Three Line Diagram WL-3365
Elementary Diagram WPA-2266
Mfr's Drawings XA-2990
Mfr's Wip. Diagram 310-327



See Revision Note 1									
REV.	DATE	BY	CHKD.	APPD.	REASON	REV.	DATE	BY	CHKD.
1	3-27-71	WCH	RLR	JRD	See Revision Note 1	2	3-27-71	WCH	RLR
2	3-27-71	WCH	RLR	JRD	See Revision Note 1	3	3-27-71	WCH	RLR

ROANE 161KV LINE	9589	959	XA-2990
LOCATION	DEVICE NO.	SERIAL NO.	WPA NO.
TENNESSEE VALLEY AUTHORITY			
DIVISION OF POWER PLANNING AND ENGINEERING			
HARRIMAN, TENN. SUBSTATION-161KV			
CONTR. & ELEM. DIAG. FOR ITC "TR-A-49"			
161KV/1600A, MOD SWITCH WITH "MO-10" MOTOR MECH.			
DATE	DESIGNED	APPROVED	SHEET 1 OF 1
9-27-71	WCH	RLR	WH-5703
SCALE	CLASS CODE		R-1
None	None		

MICROFILMED

20LS-HM


MECHANISM HOUSING (F.V.)

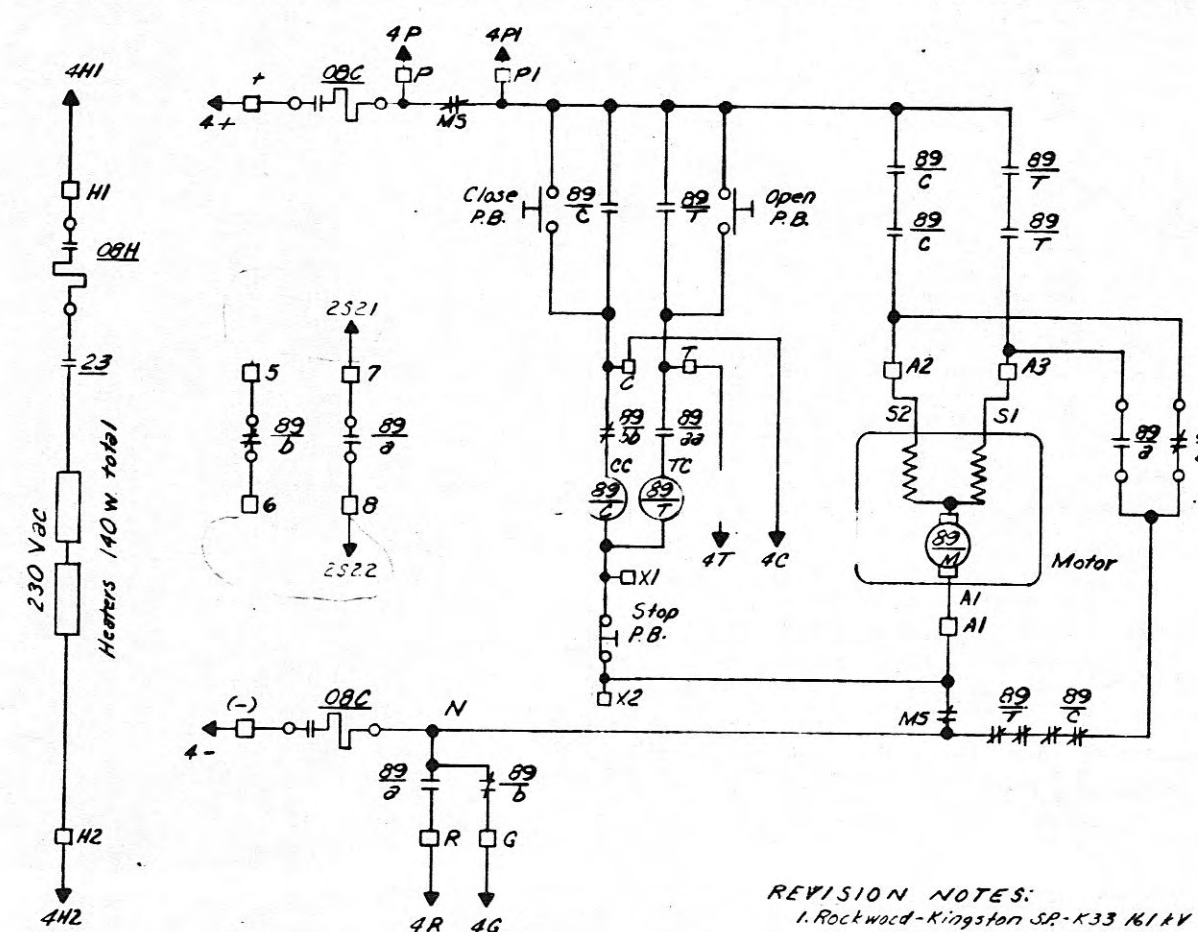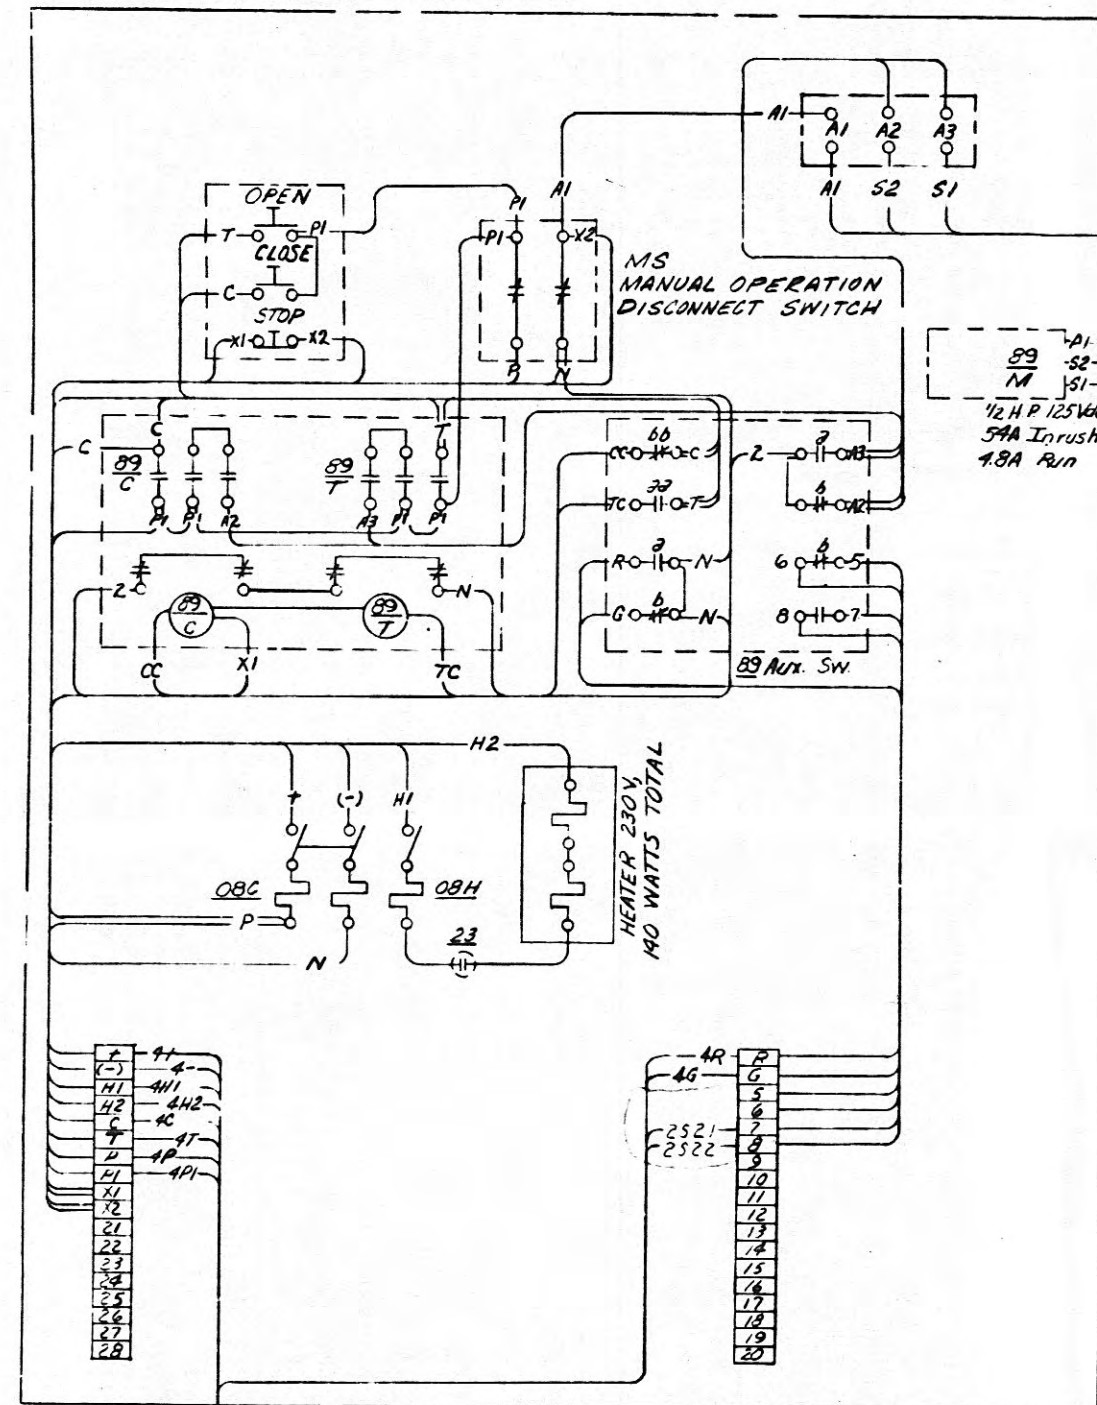

REVISION NOTES:
1. Rockwood-Kingston SR-K33 161KV
line was Kingston S.A. Line "E".
In cable C7, wires 2521 & 2522
were 3" ØVA and 2 spares
were 4" Ø4C.

REFERENCES:
Three Line Diagram WL-3365
File Diagram 110 2266
MFR's Drawings XA-2990
MFR's Win Diagram 310-327

89-1 Aux Sw. (MTD ON OPER. PIPE)

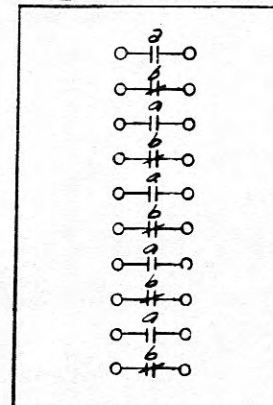

DATE	BY	CHKD	APPD
9-27-71	WEL	JLD	WEL
9-27-71	RLR	JLD	WEL
9-27-71	JLD	JLD	WEL

ROCKWOOD-KINGSTON 16-KV LINE	9459	949	XI-2990
LOCATION	DEVICE NO.	SERIAL NO.	MOD. NO. FILE
TENNESSEE VALLEY AUTHORITY			
DIVISION OF POWER PLANNING AND ENGINEERING			
HARRIMAN, TENN. SUBSTATION—161KV			
CONTR. & ELEM. DIAG. FOR ITE, "TTR-49"			
161KV, 1600A, MOD SWITCH WITH "MO-10" MOTOR MECH.			
DATE	DESIGNED	APPROVED	SHEET 1 OF 1
9-27-71	WEL	WEL	WH-5702
SCALE	None	None	R-1

MICROFILMED