




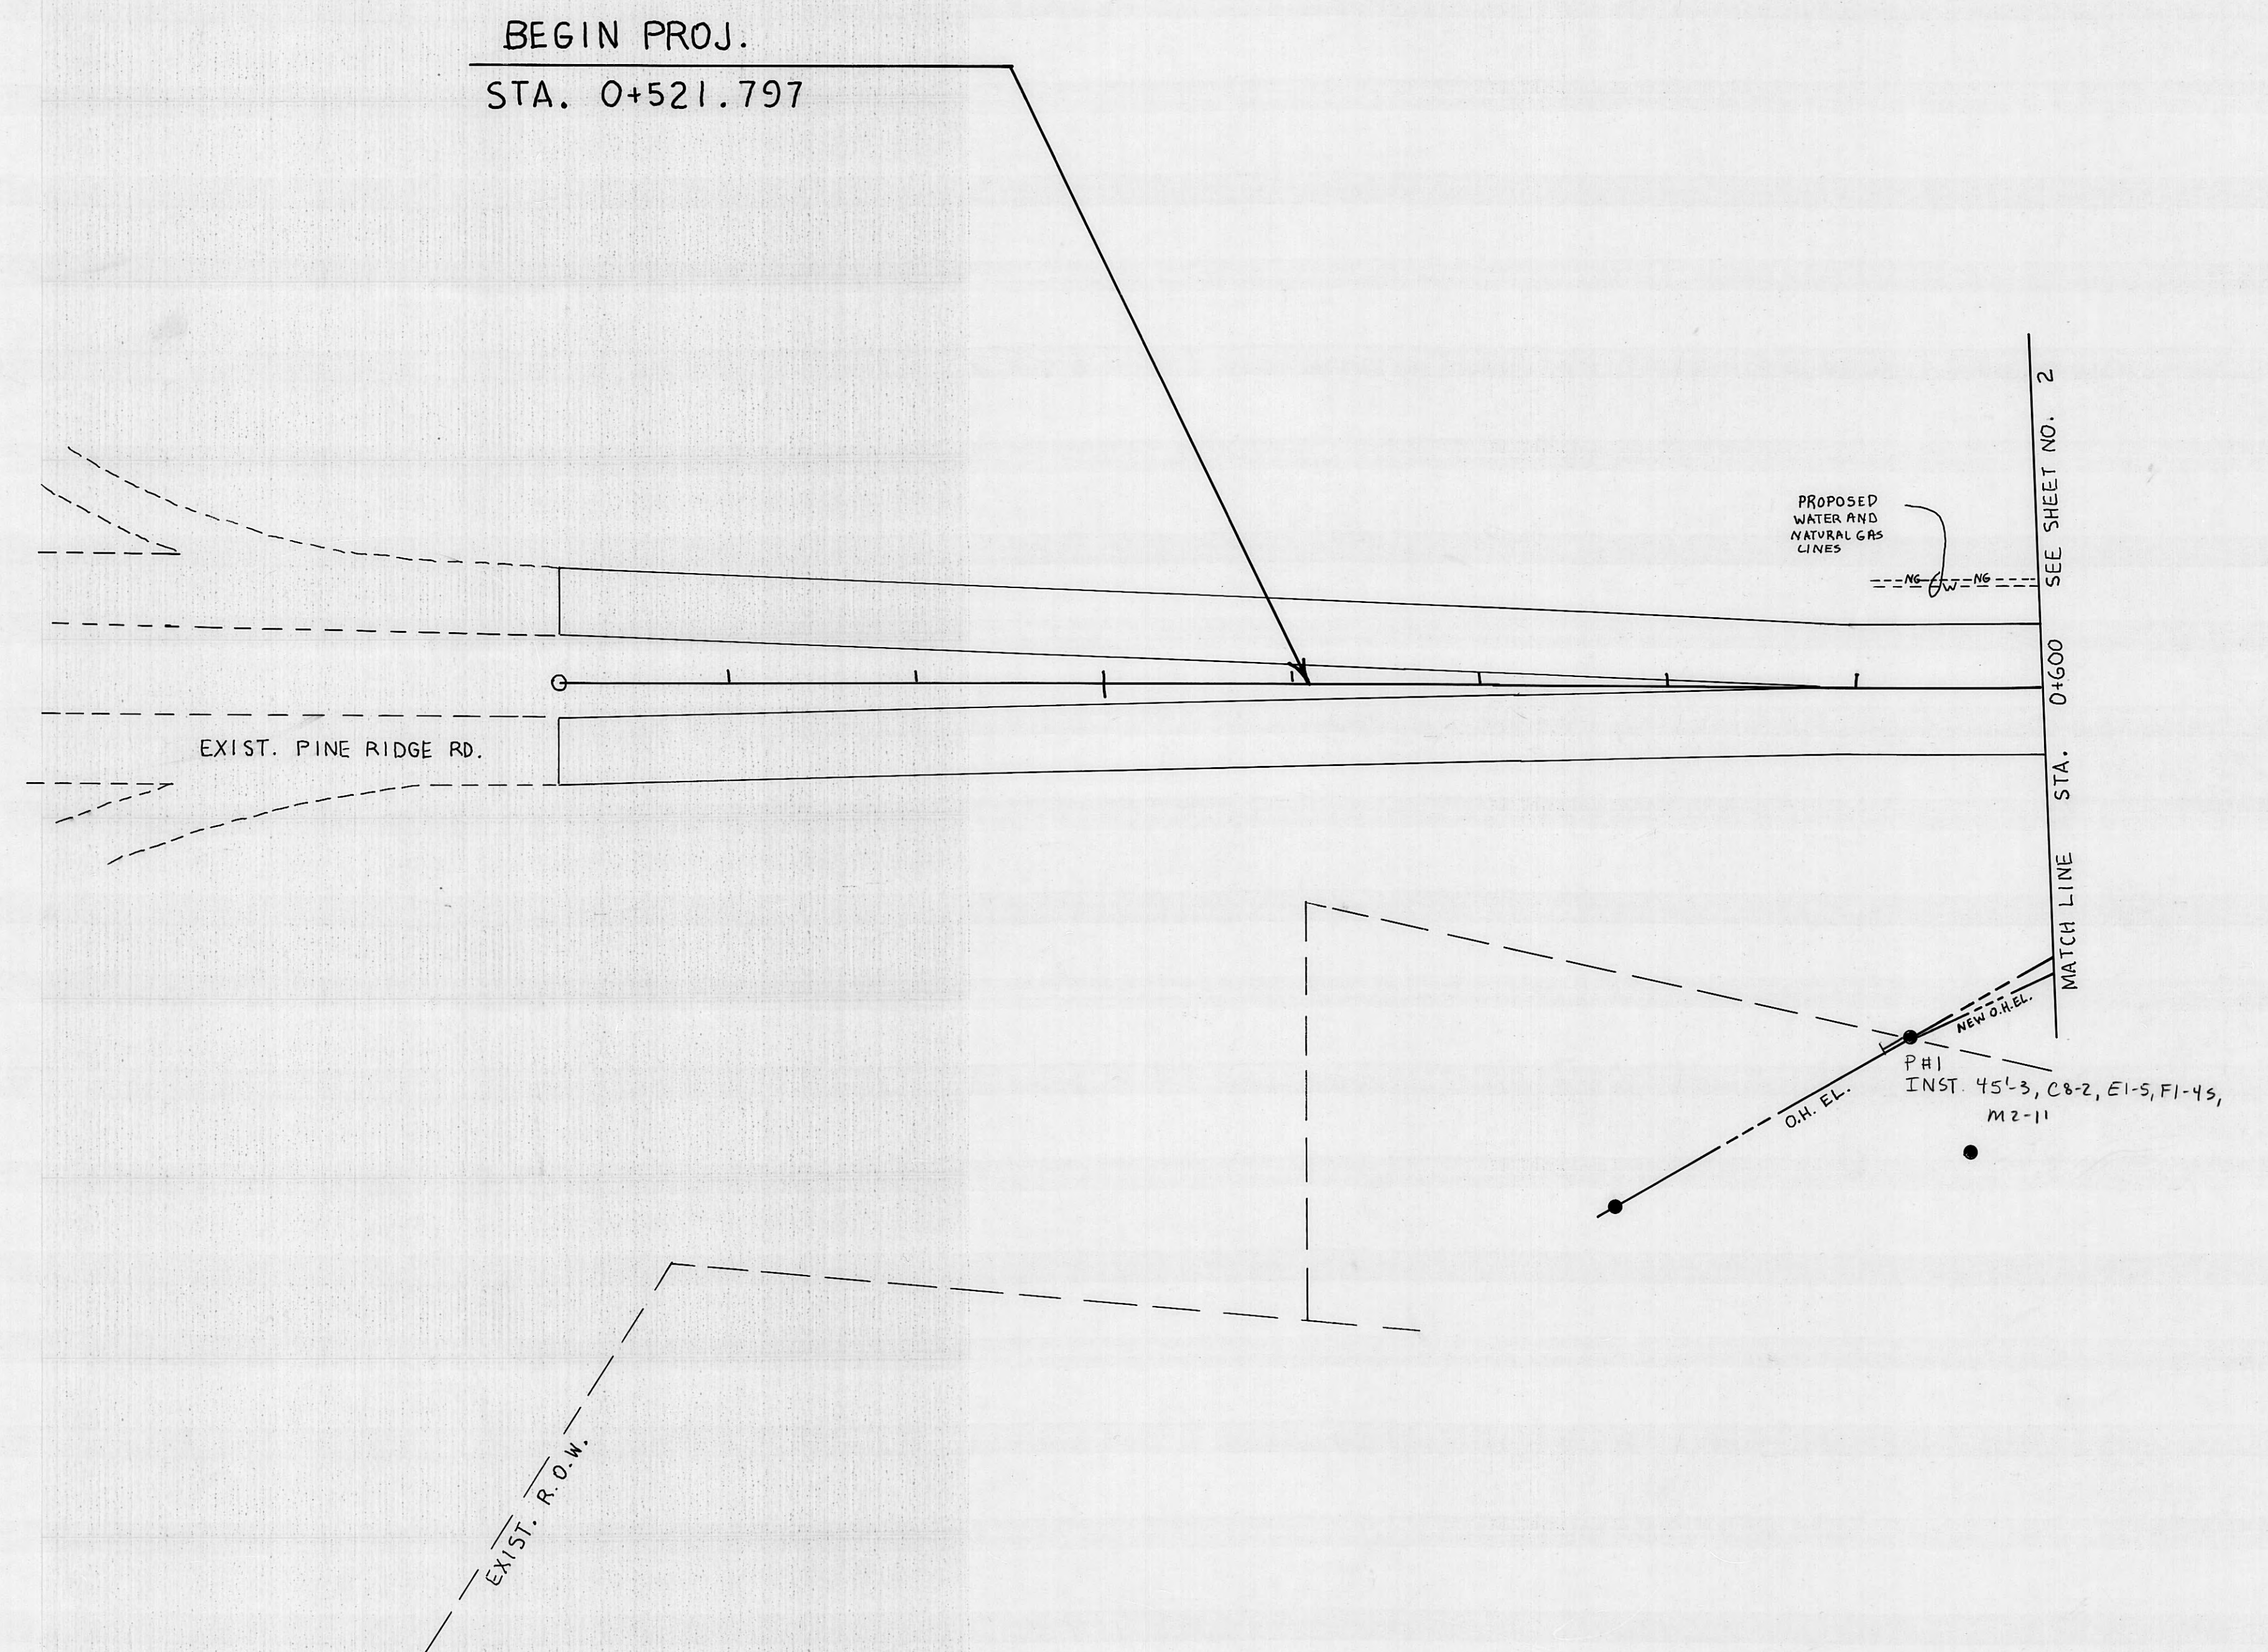


HARRIMAN UTILITY BOARD HARRIMAN, TENNESSEE		
SCALE: 1"=50'	APPROVED BY	DRAWN BY RB
DATE: 9/30/97		
PINE RIDGE RD. RELOCATIONS		
S 246-D		DRAWING NUMBER 1 of 5

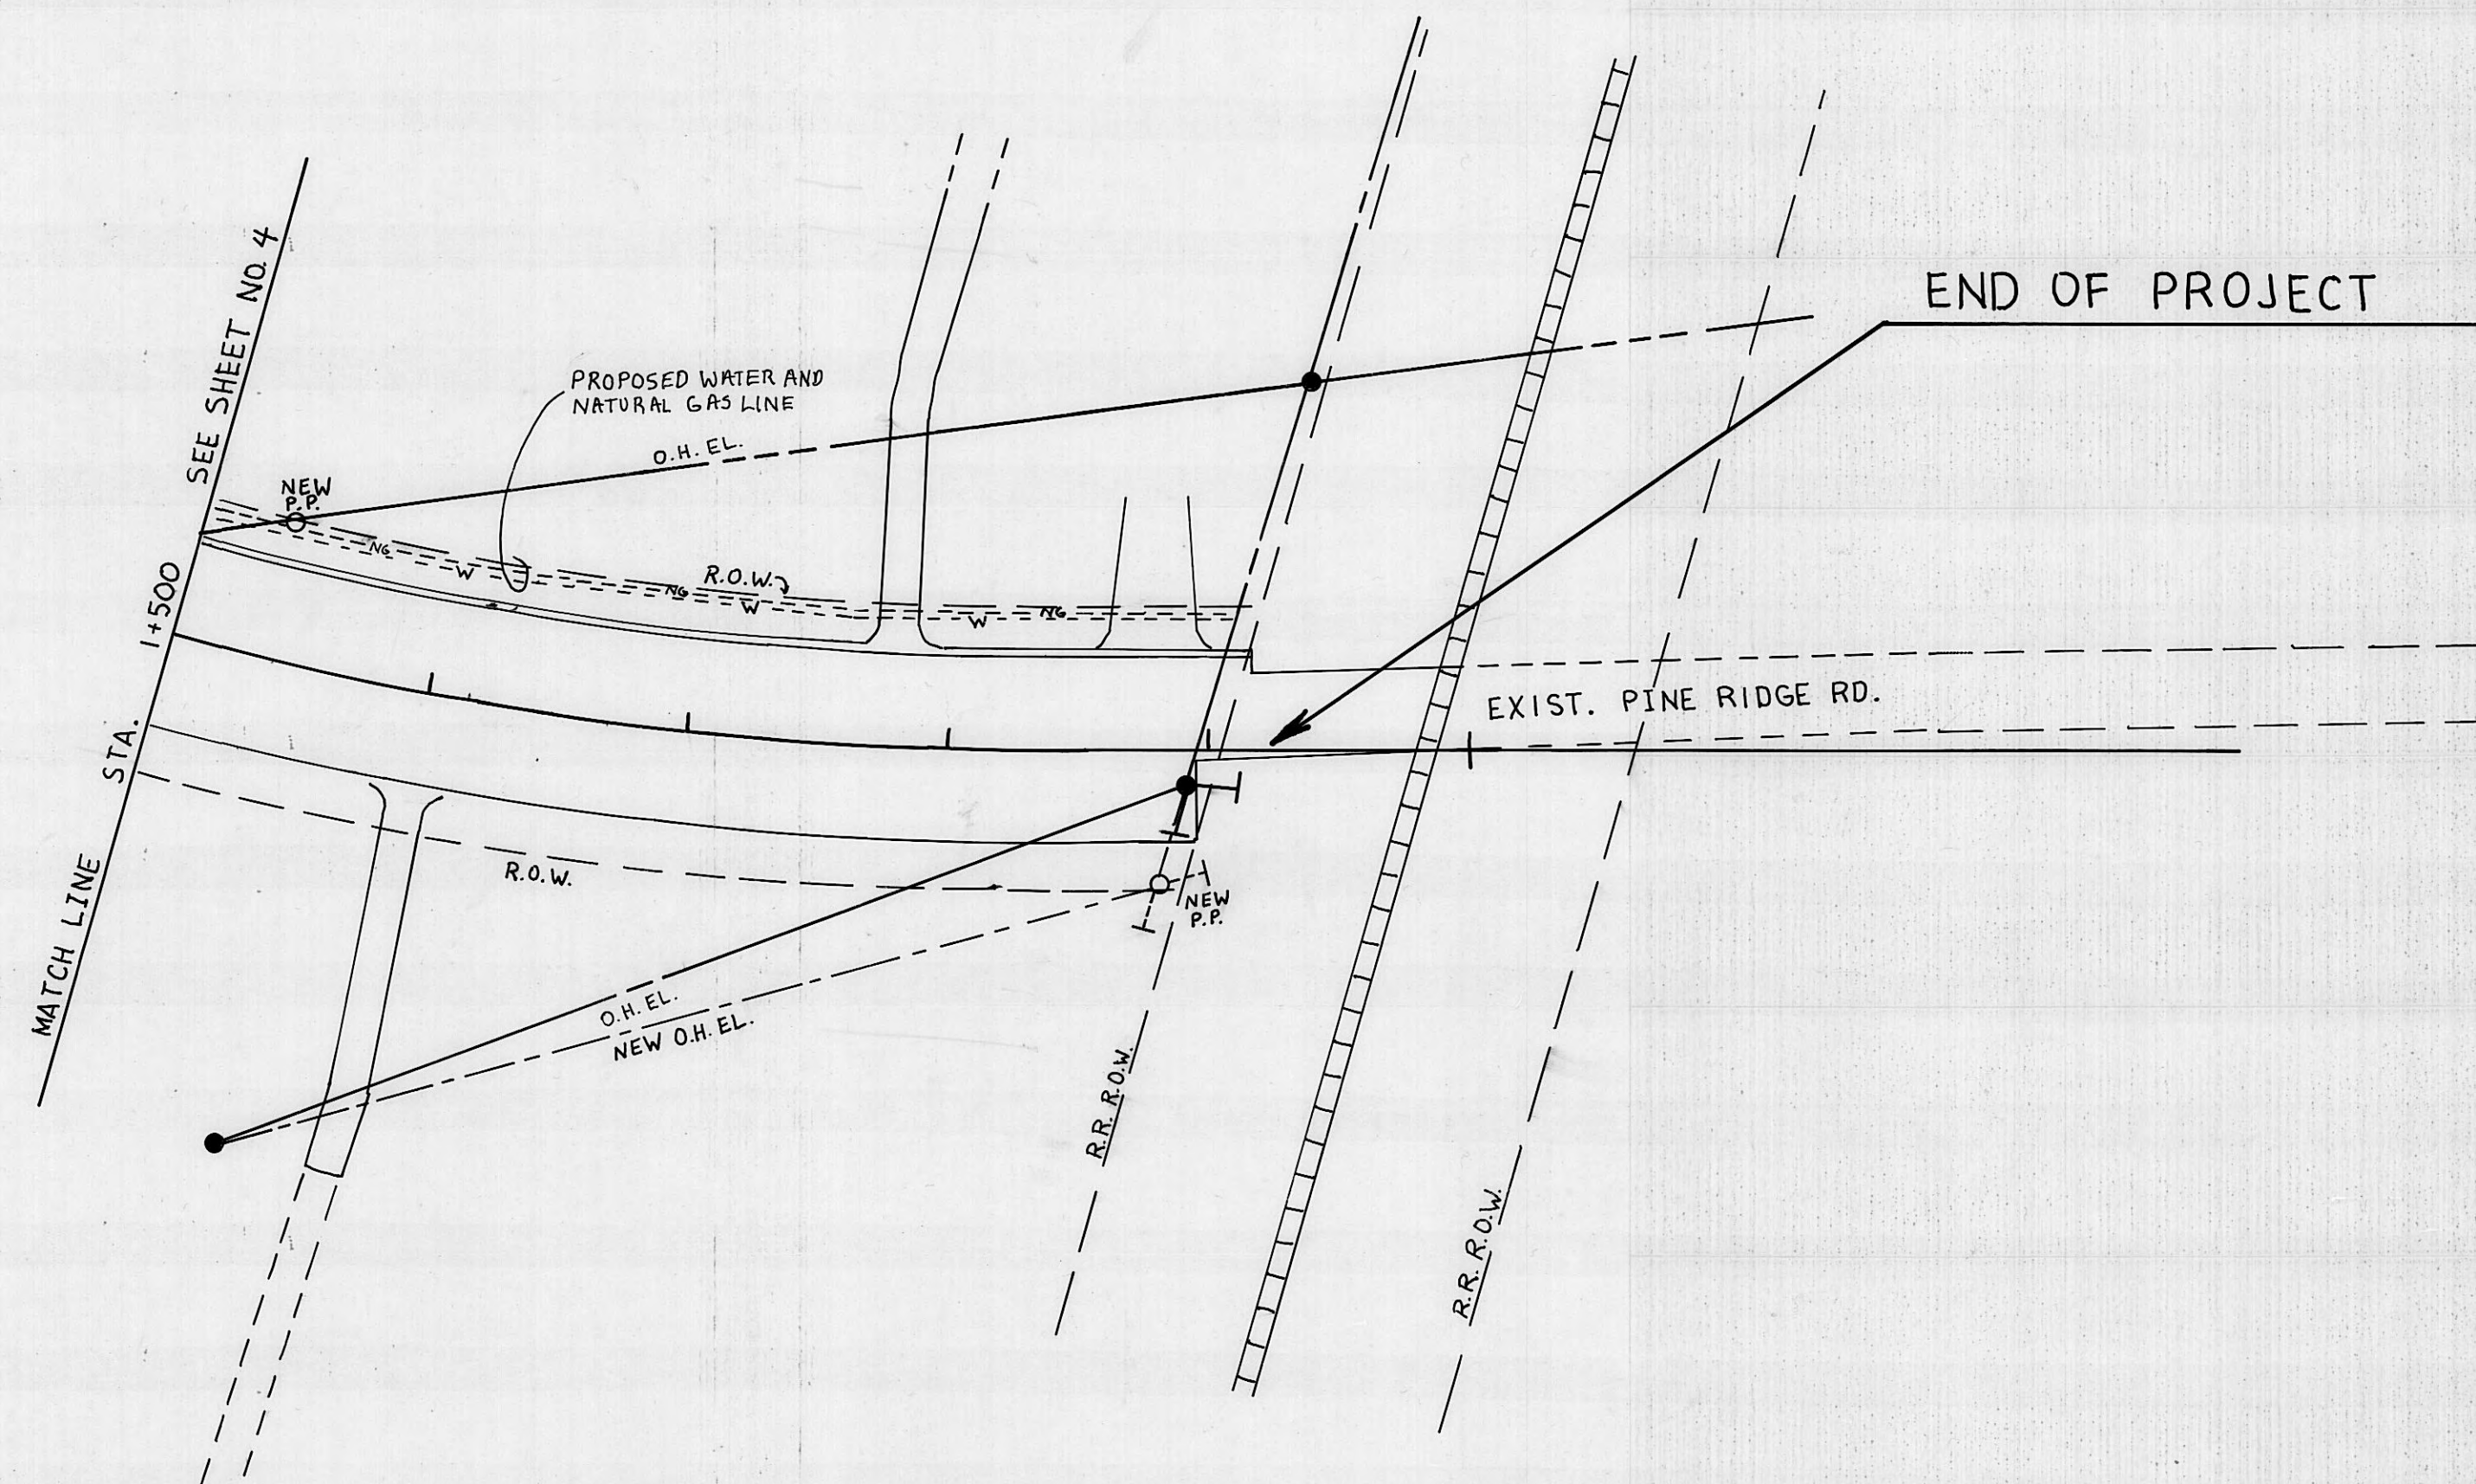


HARRIMAN UTILITY BOARD HARRIMAN, TENNESSEE		
SCALE: 1"=500'	APPROVED BY	DRAWN BY RB
DATE: 9/30/97		
PINE RIDGE RD. RELOCATIONS		
		DRAWING NUMBER 5 of 5

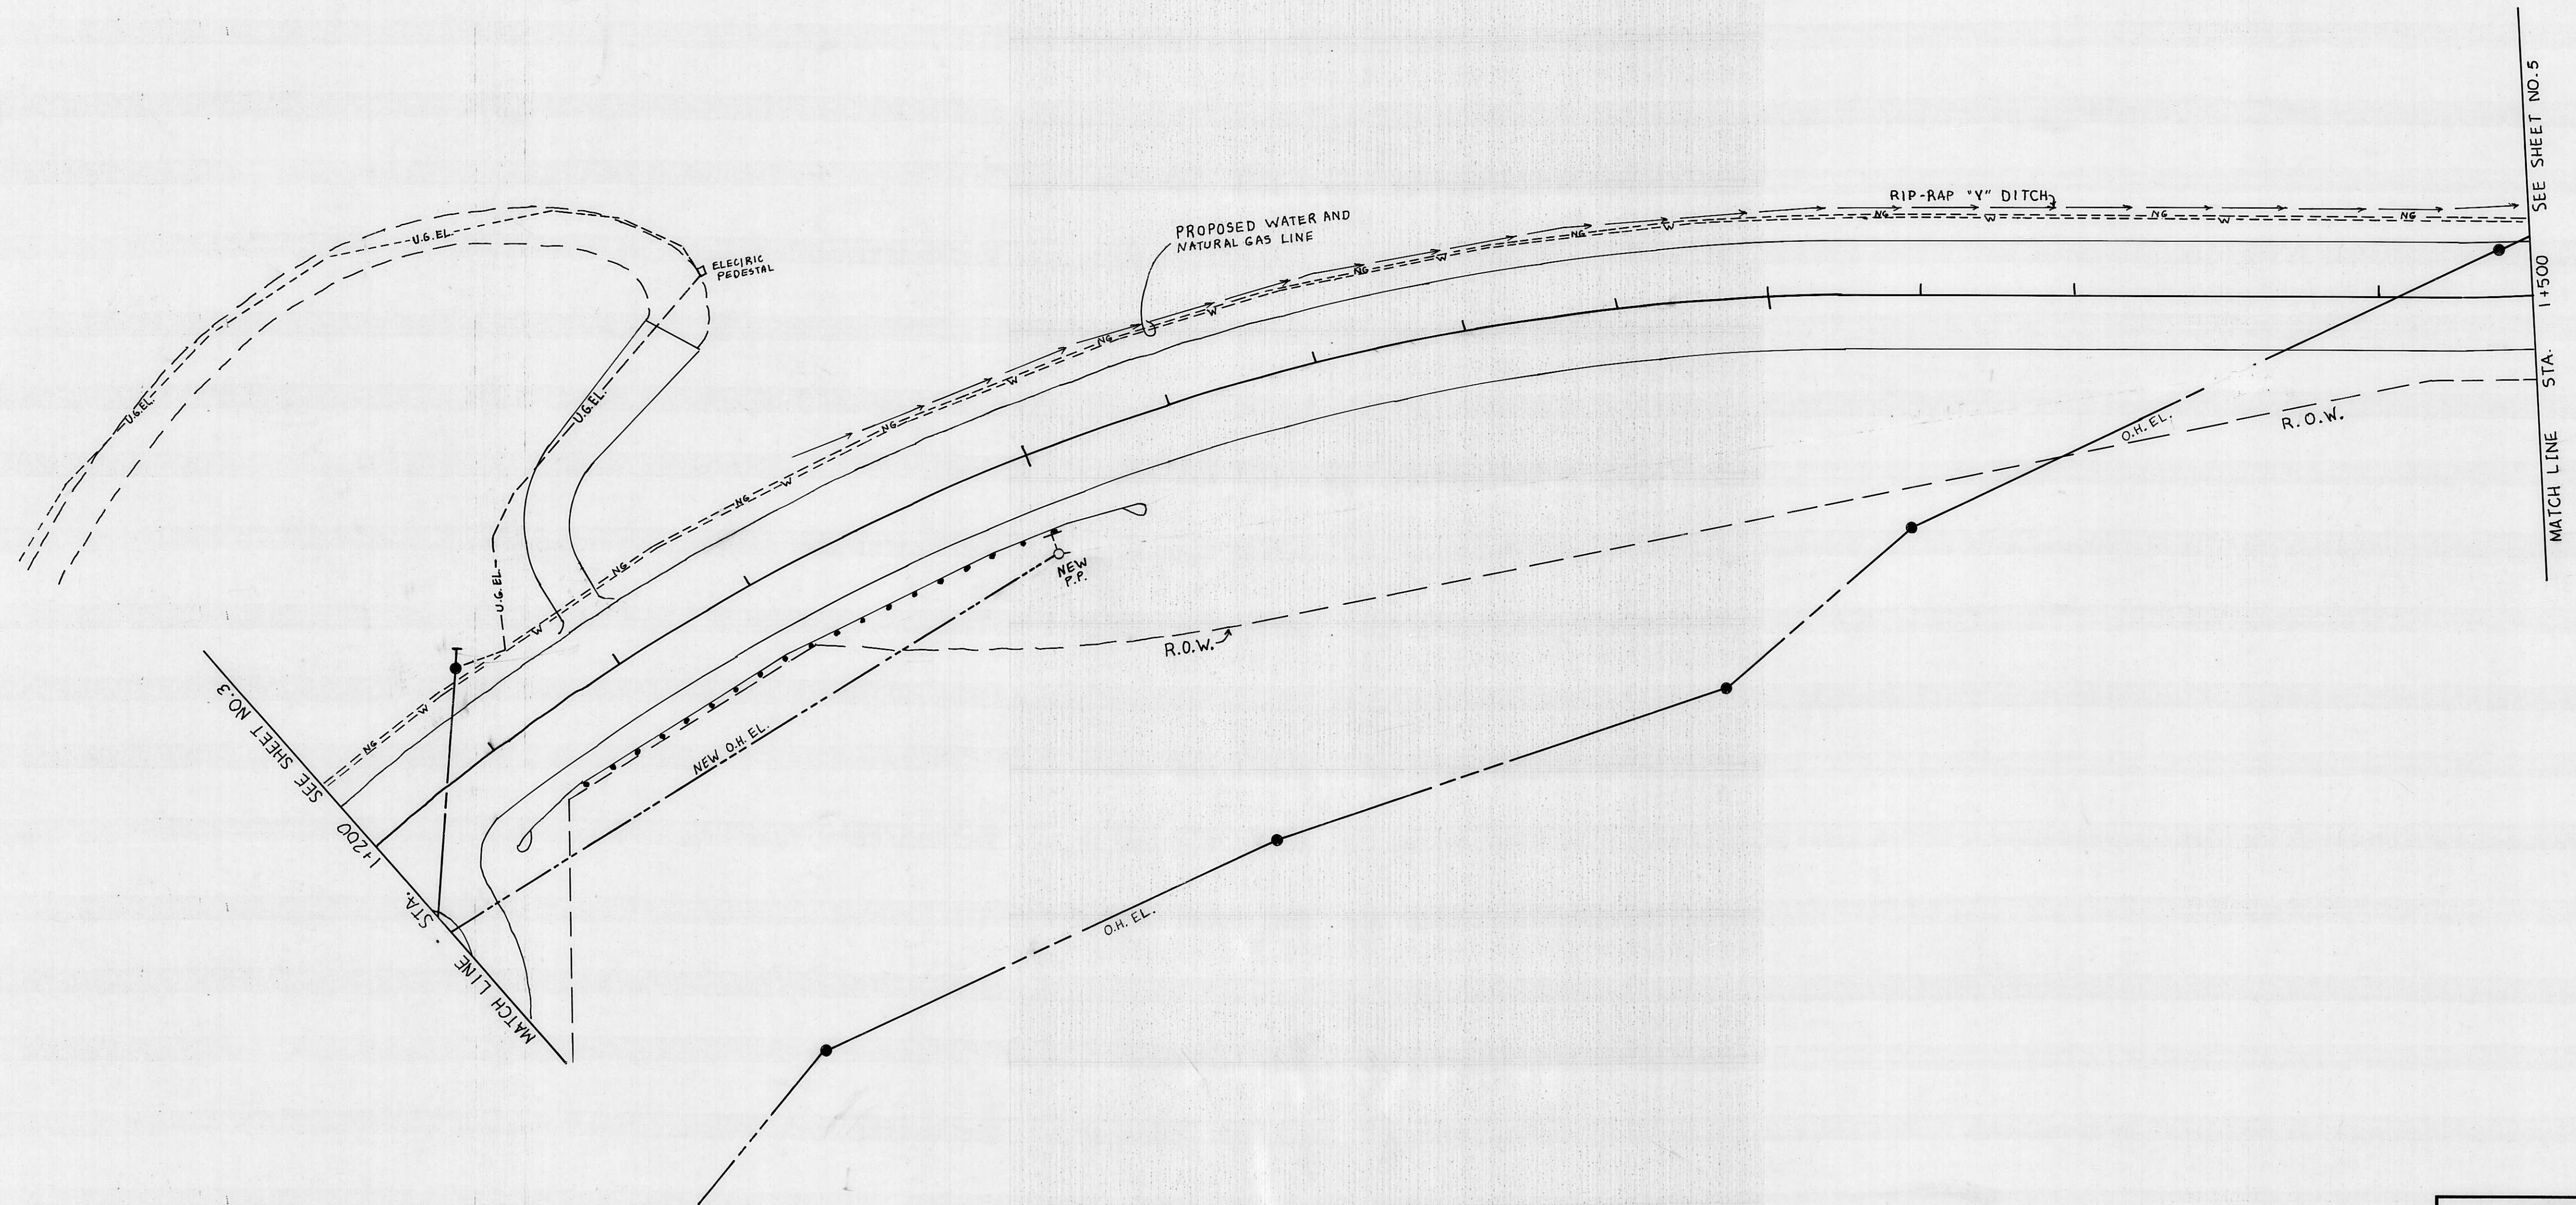

HARRIMAN UTILITY BOARD HARRIMAN, TENNESSEE		
SCALE: 1"=500'	APPROVED BY	DRAWN BY RB
DATE: 9/30/97		
PINE RIDGE RD. RELOCATIONS		
S 246 -D		DRAWING NUMBER 4 of 5

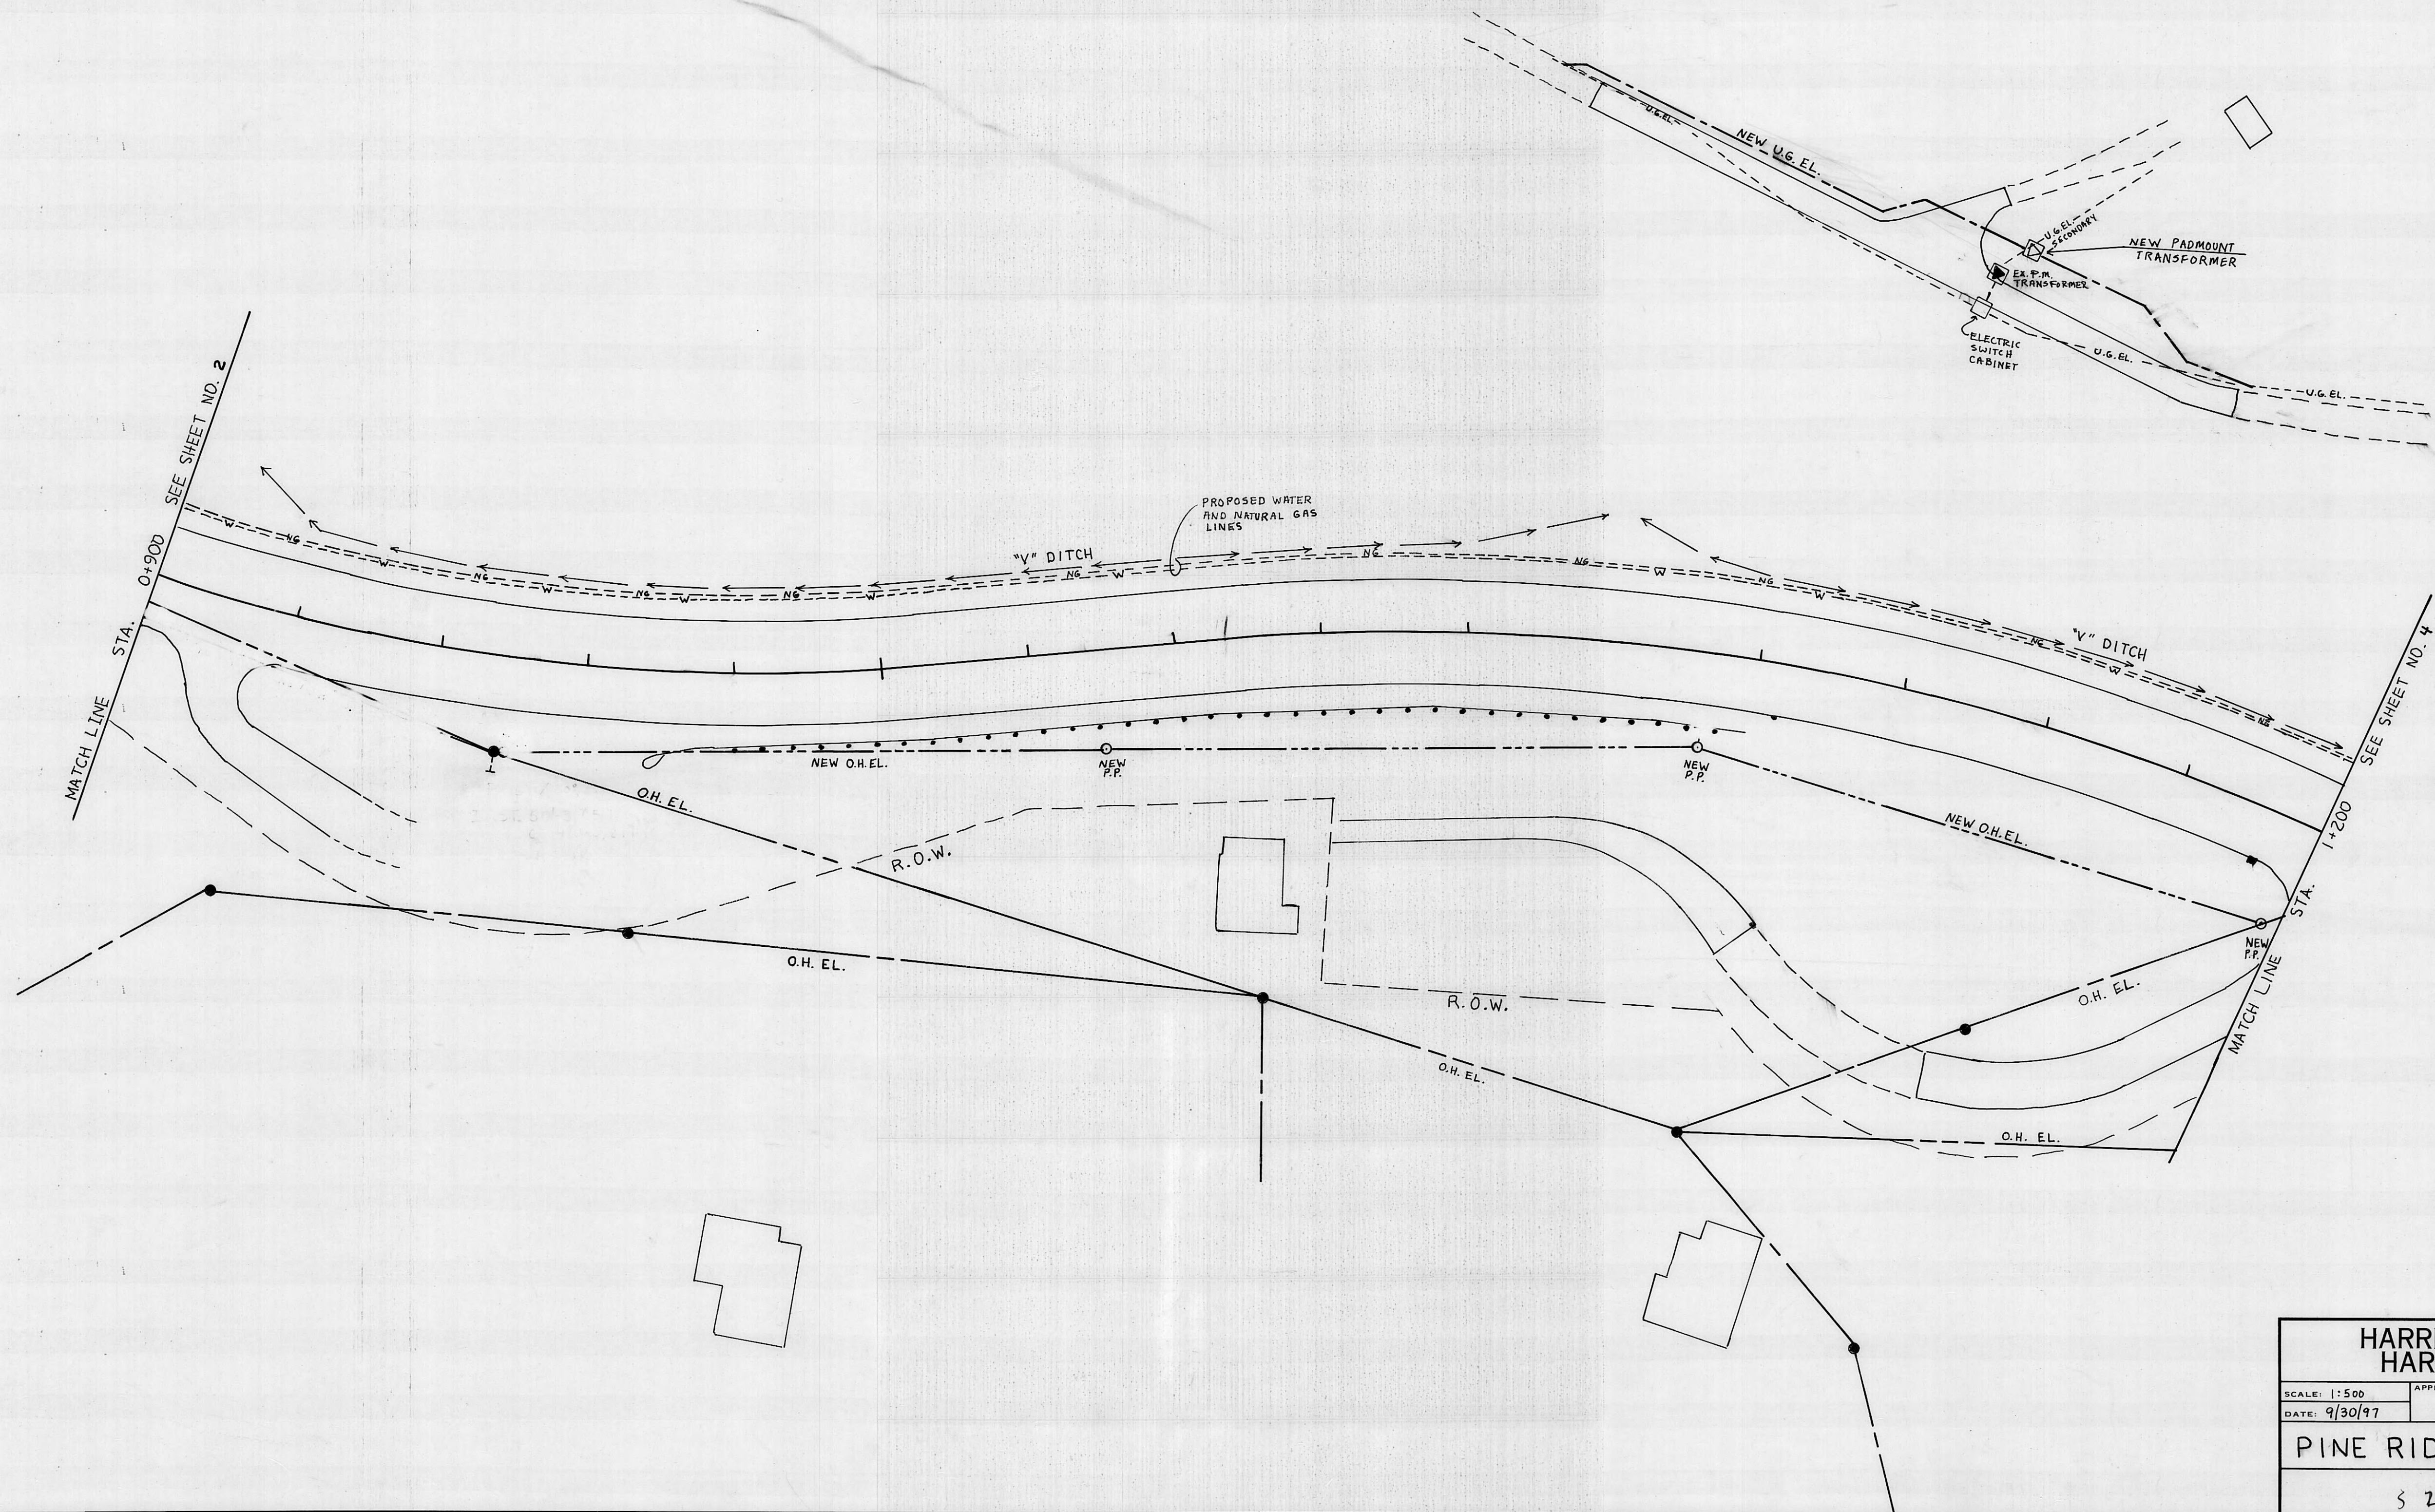

HARRIMAN UTILITY BOARD HARRIMAN, TENNESSEE		
SCALE: 1"=500'	APPROVED BY	DRAWN BY R.B.
DATE: 9/30/97		
PINE RIDGE RD. RELOCATIONS		
S 246-D		DRAWING NUMBER 3 of 5

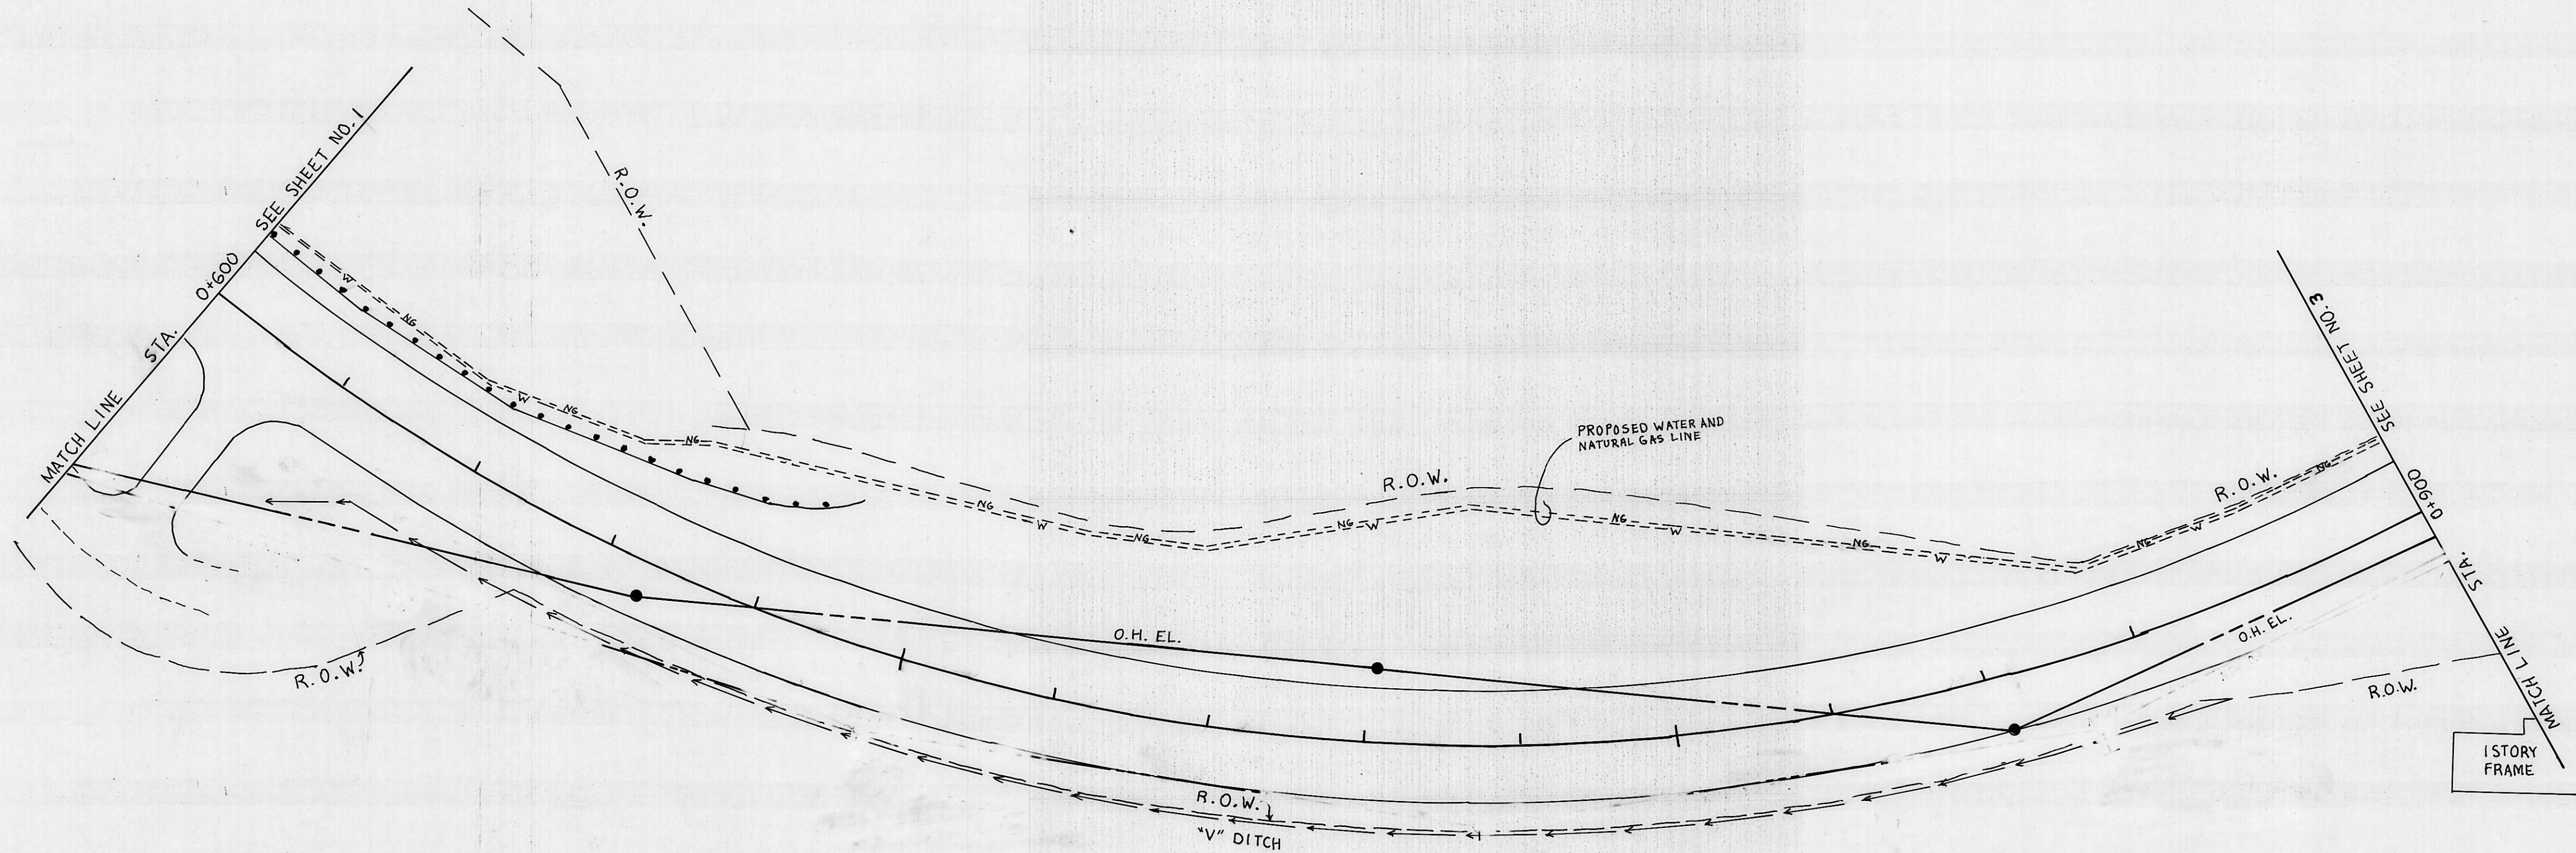

PROPOSED GAS LINE INFORMATION

CONTENTS	NATURAL GAS
OUTSIDE DIAMETER	4.5"
PIPE MATERIAL	PE
SPECIFICATION	3408 SDR11
WALL THICKNESS	0.409"
ACTUAL WORKING PRESSURE	45 PSI
TYPE OF JOINT	FUSION
COATING	NONE
METHOD OF INSTALLATION	TRENCH
CATHODIC PROTECTION	NO
BURY DEPTH	36"
SIZE AND HEIGHT OF VENT	NA

HARRIMAN UTILITY BOARD HARRIMAN, TENNESSEE		
SCALE: 1"=50'	APPROVED BY	DRAWN BY RB
DATE: 9/30/97		
PINE RIDGE RD. RELOCATIONS		
8296-D	DRAWING NUMBER 2 of 5	