



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: *AS* DATE:

PROJECT NO.: 91017


CHECKED: *CONST* DATE:

SHEET ____ OF ____

CLIENT: *Oakdale/Wolfe Branch Utility District Water Line Replacement Phase 3*

SUBJECT: *2" AND 4" Gate Valves ON Piney Church Road AT BRIAN SHADDEN ROAD*

4-92 D.K.

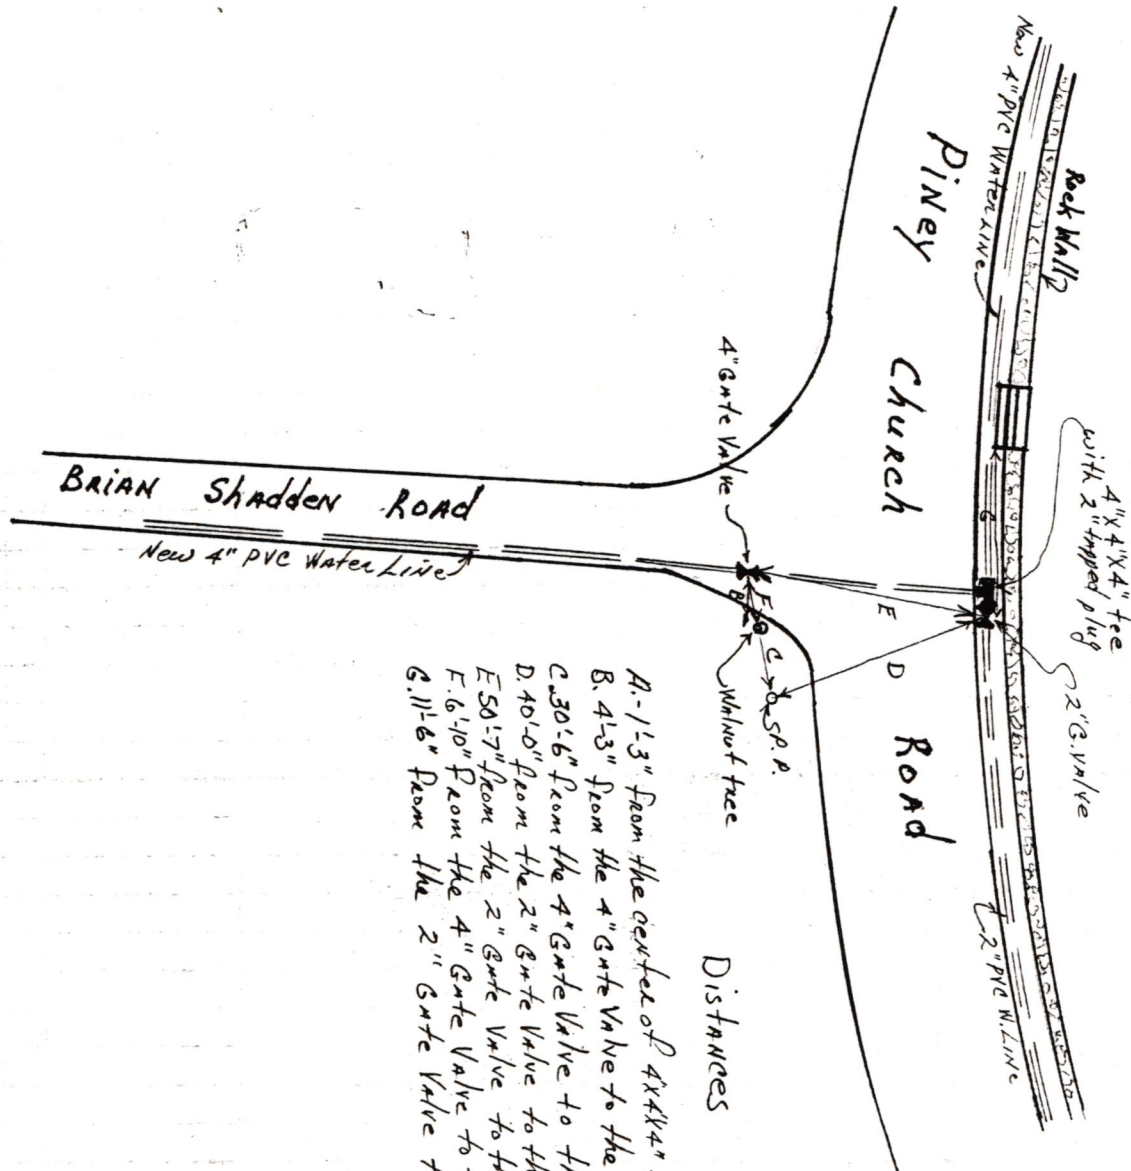

- A. 1'-3" From the center of 4" x 4" tee to center of 2" valve.*
B. 4'-3" From the 4" Gate Valve to the Stop Sign Post.
C. 30'-6" From the 4" Gate Valve to the Power Pole.
D. 40'-0" From the 2" Gate Valve to the Power Pole.
E. 50'-7" From the 2" Gate Valve to the 4" Gate Valve.
F. 6'-10" From the 4" Gate Valve to the Walnut tree.
G. 11'-6" From the 2" Gate Valve to the concrete steps.