



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: *AS* DATE:

PROJECT NO.: 91017


~~ENGINEER~~: *CONST* DATE:

SHEET ____ OF ____

CLIENT: *Oakdale/Wolfe Branch U.D. Water Line Replacement Phase 3*

SUBJECT: *2" Gate Valve at end of 6" Water Line on Hwy 328 North*

5-92 D.K.

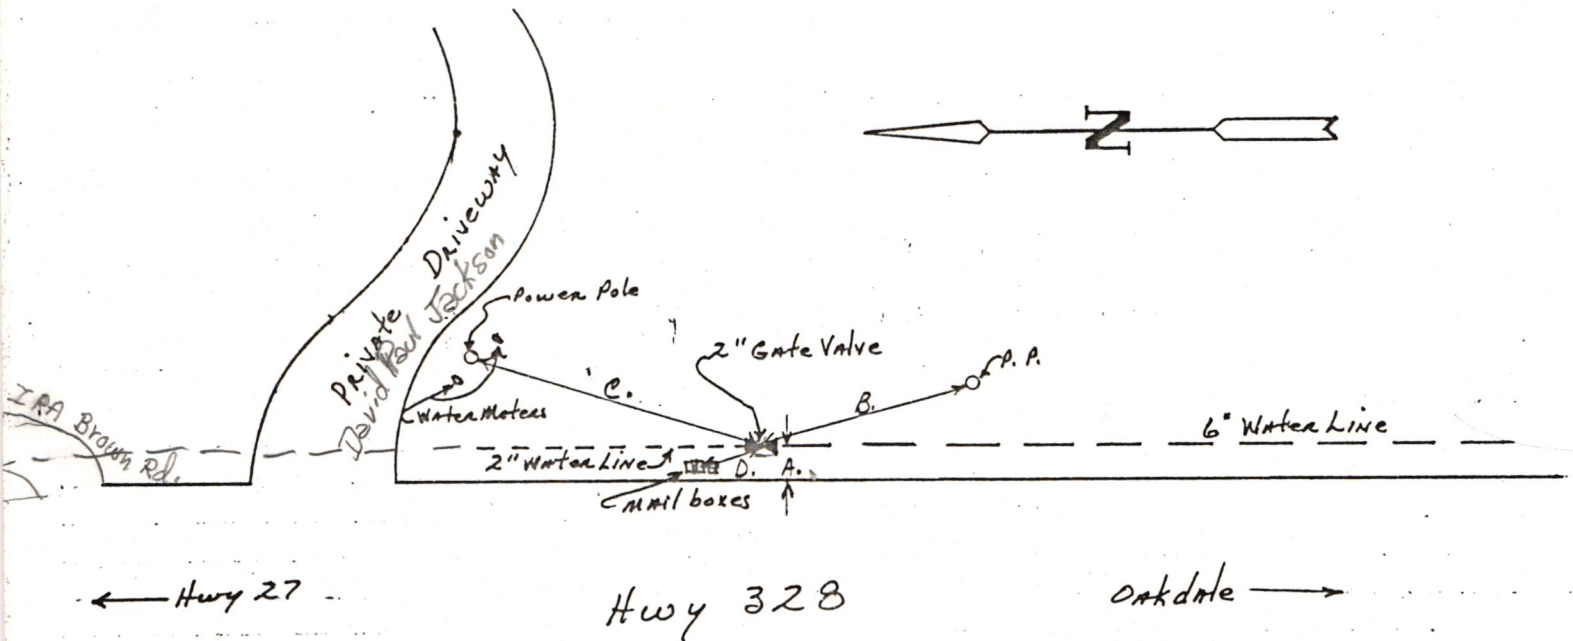

Distances:

- A. 9'-5" 2" Gate Valve to edge of pavement.
- B. 55'-0" 2" Gate Valve to power pole.
- C. 45'-0" 2" Gate Valve to power pole.
- D. 8'-8" 2" Gate Valve to middle mail box.