



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS DATE:

PROJECT NO.: 91017


CHECKED: CONST DATE:

SHEET ____ OF ____

CLIENT: Oakdale/Wolfe Branch U. D Water Line Replacement Phase 3

SUBJECT: 2" Tap & Gate Valve ON Hwy 328 for Jackson McGill Subdivision

tap made 4-22-92 DK

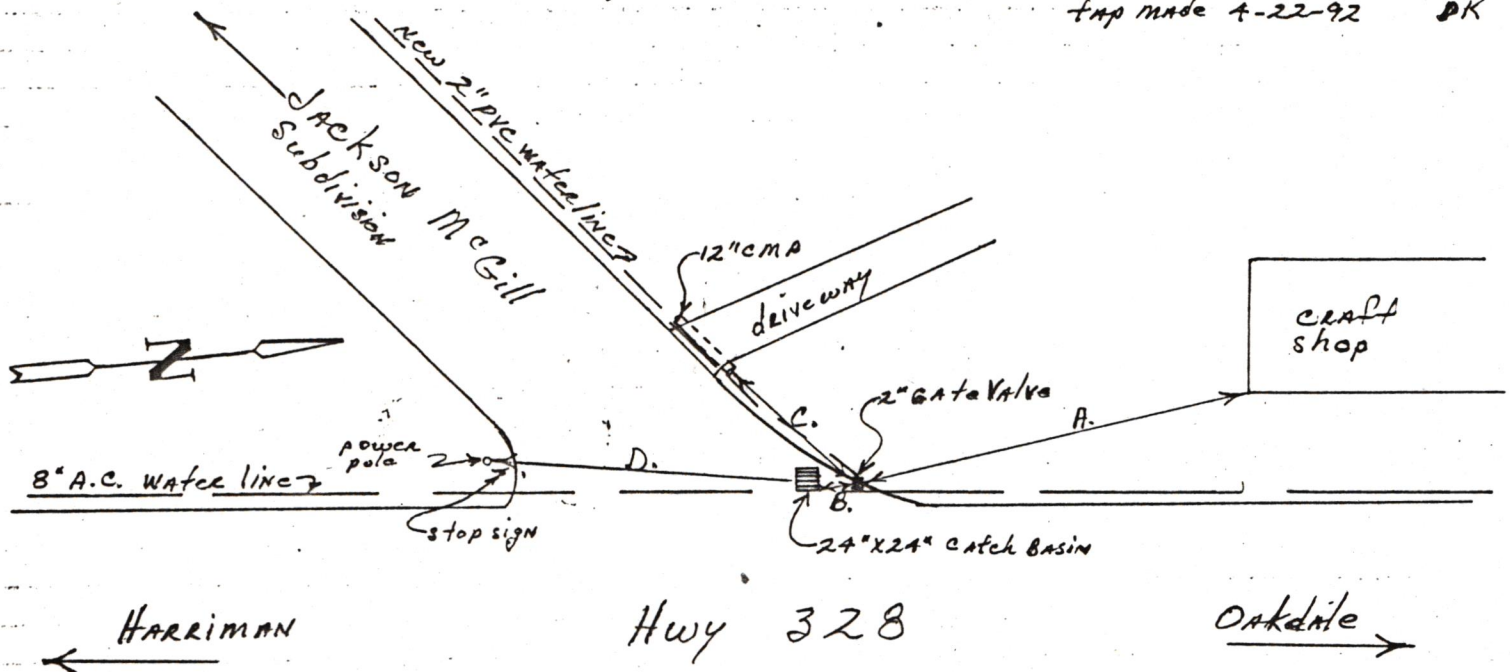

DISTANCES:

- A. 36'-6" 2" Gate Valve to CORNER of Building.
- B. 4'-0" 2" Gate Valve to CORNER of Catch Basin.
- C. 32'-0" 2" Gate Valve to END of 12" CMP.
- D. 63'-0" 2" Gate Valve to POWER Pole.
- E. 1'-0" 2" Gate Valve to CENTER of 8" Water Line.
- F. 5'-0" 2" Gate Valve to Hwy 328 Pavement Edge

