



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS DATE:

PROJECT NO.: 91017

CHECKED: CONST DATE:


SHEET 3-3.1 OF PLANS

CLIENT: Oakdale/Wolfe Branch Utility District Water Line Replacement Phase 3

SUBJECT: 4" Gate Valve on Ben Henry Road

Installed 2-22-92

DK

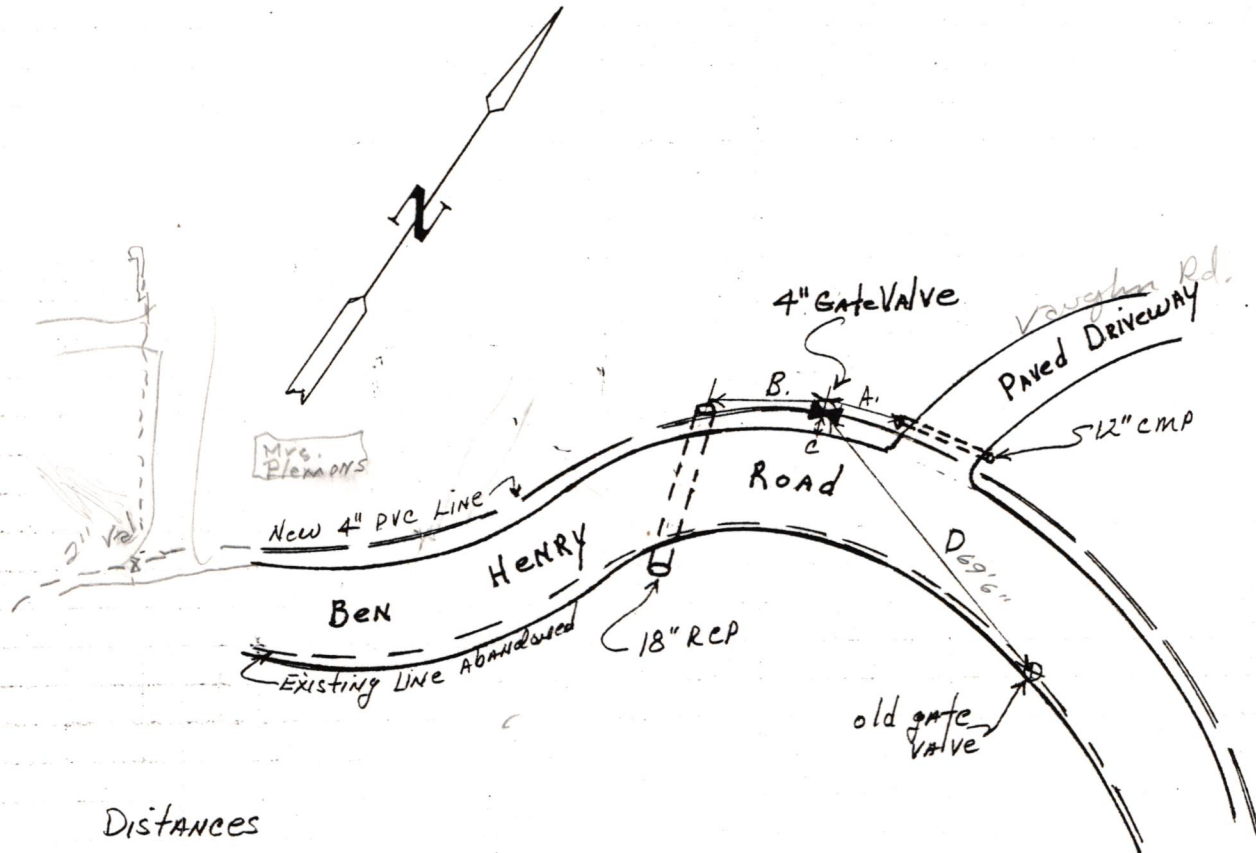

Distances

- A. Center of 12" CMP to center of 4" Gate Valve - 20'-10"
- B. Center of 18" RCP to center of 4" Gate Valve - 42'-0"
- C. Edge of pavement of street to center 4" G.V. - 3'-6"
- D. Existing valve box to center of 4" Gate Valve - 69'-6"