



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: *AS* DATE:

PROJECT NO.: 91017


CHECKED: *CONST* DATE:

SHEET ____ OF ____

CLIENT: *Dakdale / Wolfe Branch Utility District Water Line Replacement Phase 3*

SUBJECT: *4" to 2" Reducer AND 2" Gate Valve ON BEN HENRY ROAD*

492 DK

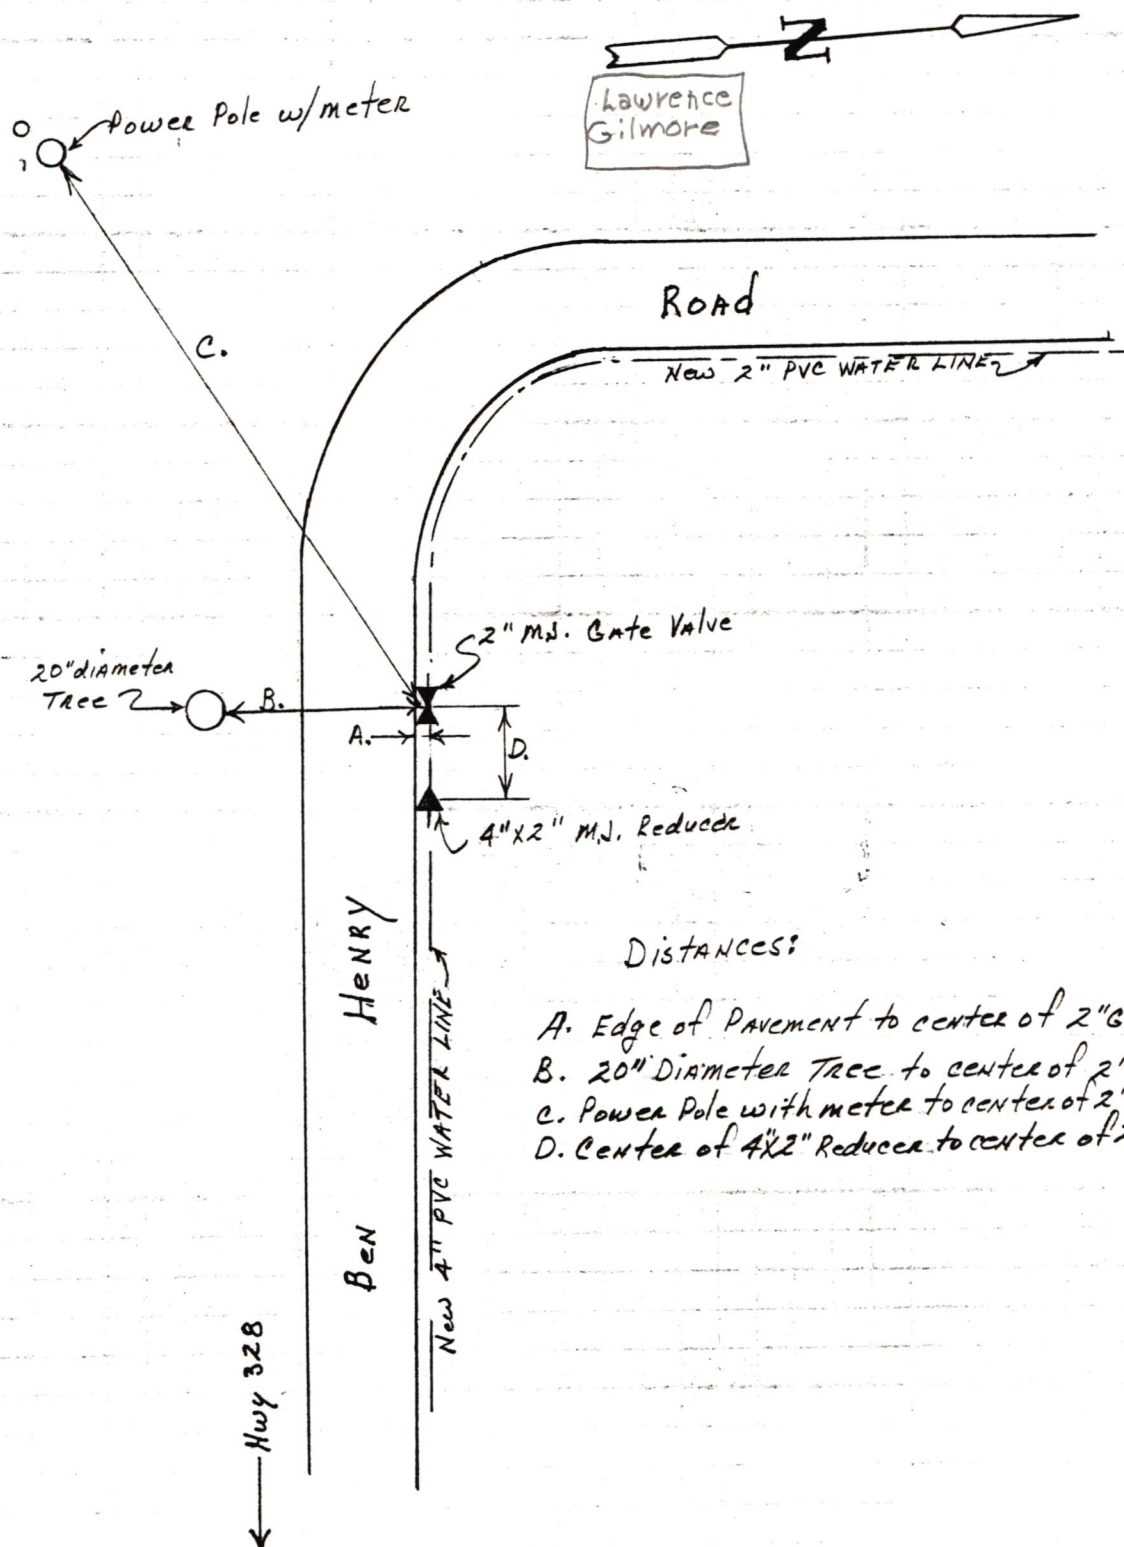

DISTANCES:

- A. Edge of Pavement to center of 2" G. Valve - 4'-6"
- B. 20" Diameter Tree to center of 2" G. V. - 28'-4"
- C. Power Pole with meter to center of 2" G. V. - 66'-0"
- D. Center of 4" x 2" Reducer to center of 2" G. V. - 10'-0"