



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS DATE:

PROJECT NO.: 91017


CHECKED: CONST DATE:

SHEET ____ OF ____

CLIENT: Oakdale/Wolfe Branch U.D. Water Line Replacement Phase 3

SUBJECT: 6" Gate Valve on Leopper Road and 2" Gate Valve for Hunnicut Road

D.K.

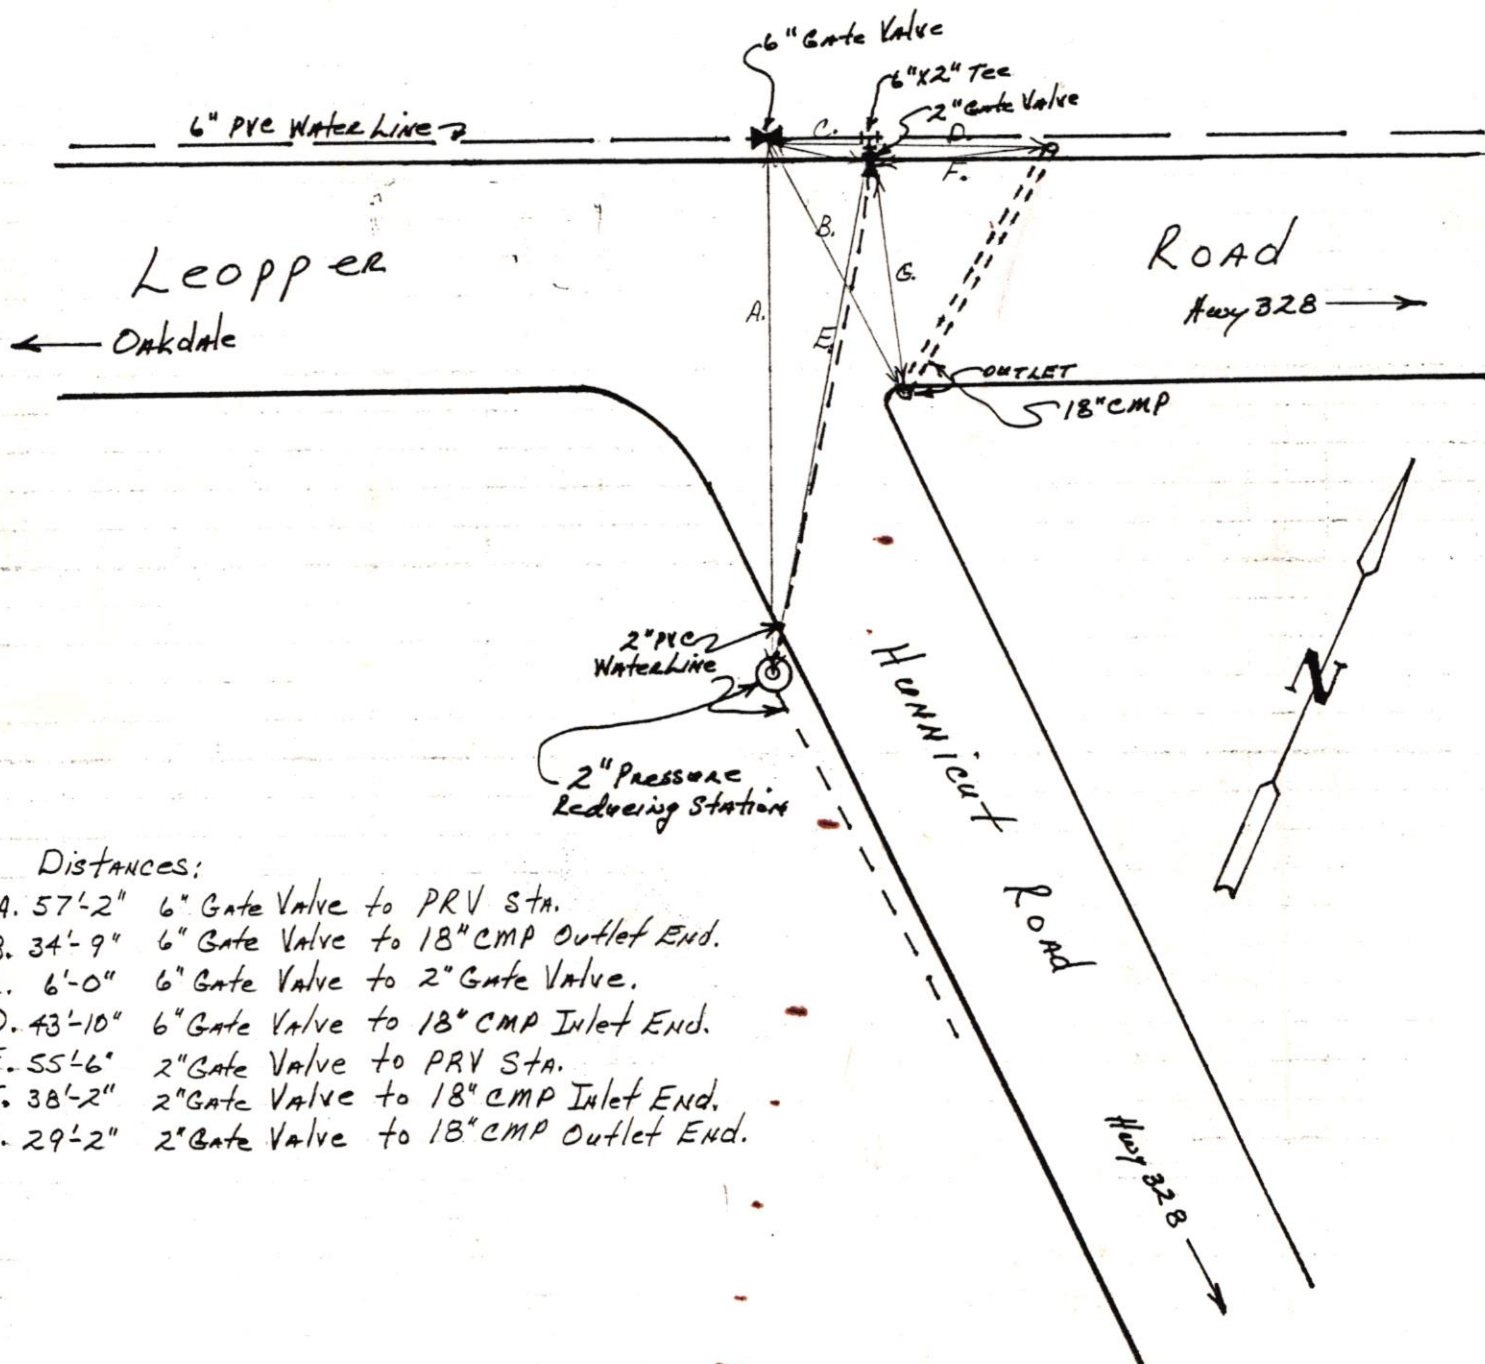

Distances:

- A. 57'-2" 6" Gate Valve to PRV Sta.
- B. 34'-9" 6" Gate Valve to 18" CMP Outlet End.
- C. 6'-0" 6" Gate Valve to 2" Gate Valve.
- D. 43'-10" 6" Gate Valve to 18" CMP Inlet End.
- E. 55'-6" 2" Gate Valve to PRV Sta.
- F. 38'-2" 2" Gate Valve to 18" CMP Inlet End.
- G. 29'-2" 2" Gate Valve to 18" CMP Outlet End.

