



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS

DATE:

PROJECT NO.: 91017

CHECKED: CONSTA DATE:


SHEET OF

CLIENT: Oakdale/Wolfe Branch Utility District Water Line Replacement Phase 3

SUBJECT: Boswell Chapel Baptist Church 2" Gate Valve and Line at Hwy 328

Installed 1-15-92

D.K.

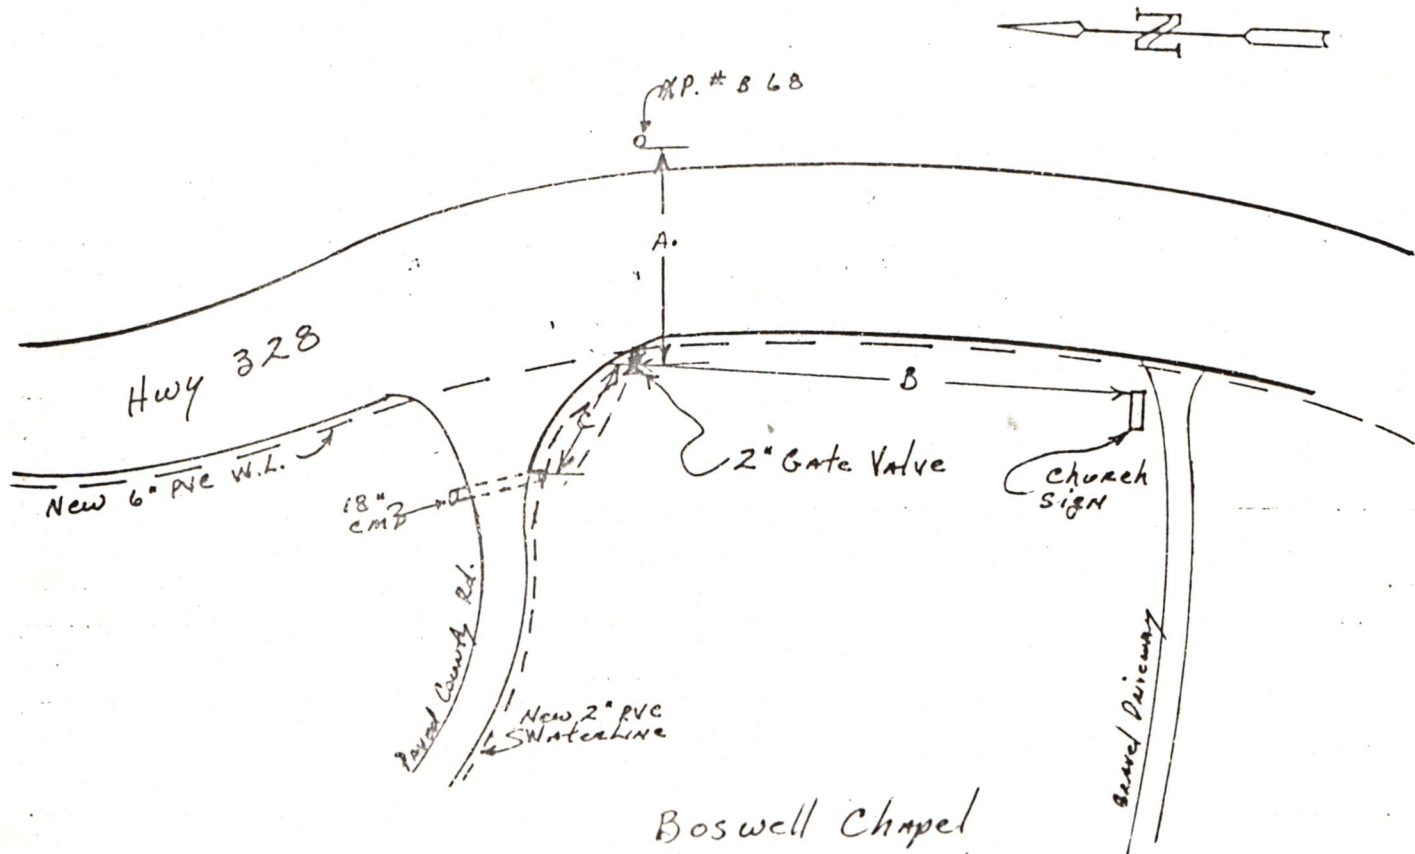

Distances:

Boswell Chapel
Baptist church
building & grounds

- A. Center of 2" Gate Valve to
Ph. Pole # 8-68 ——— 46'-6"
- B. Center of 2" Gate Valve to
church sign base NE corner — 46'-0"
- C. Center of 2" Gate Valve to
center of 18" CMP ——— 45'-6"
- D. Center of 2" Gate Valve to
center of 6"x6"x2" Tee ——— 1'-0"