


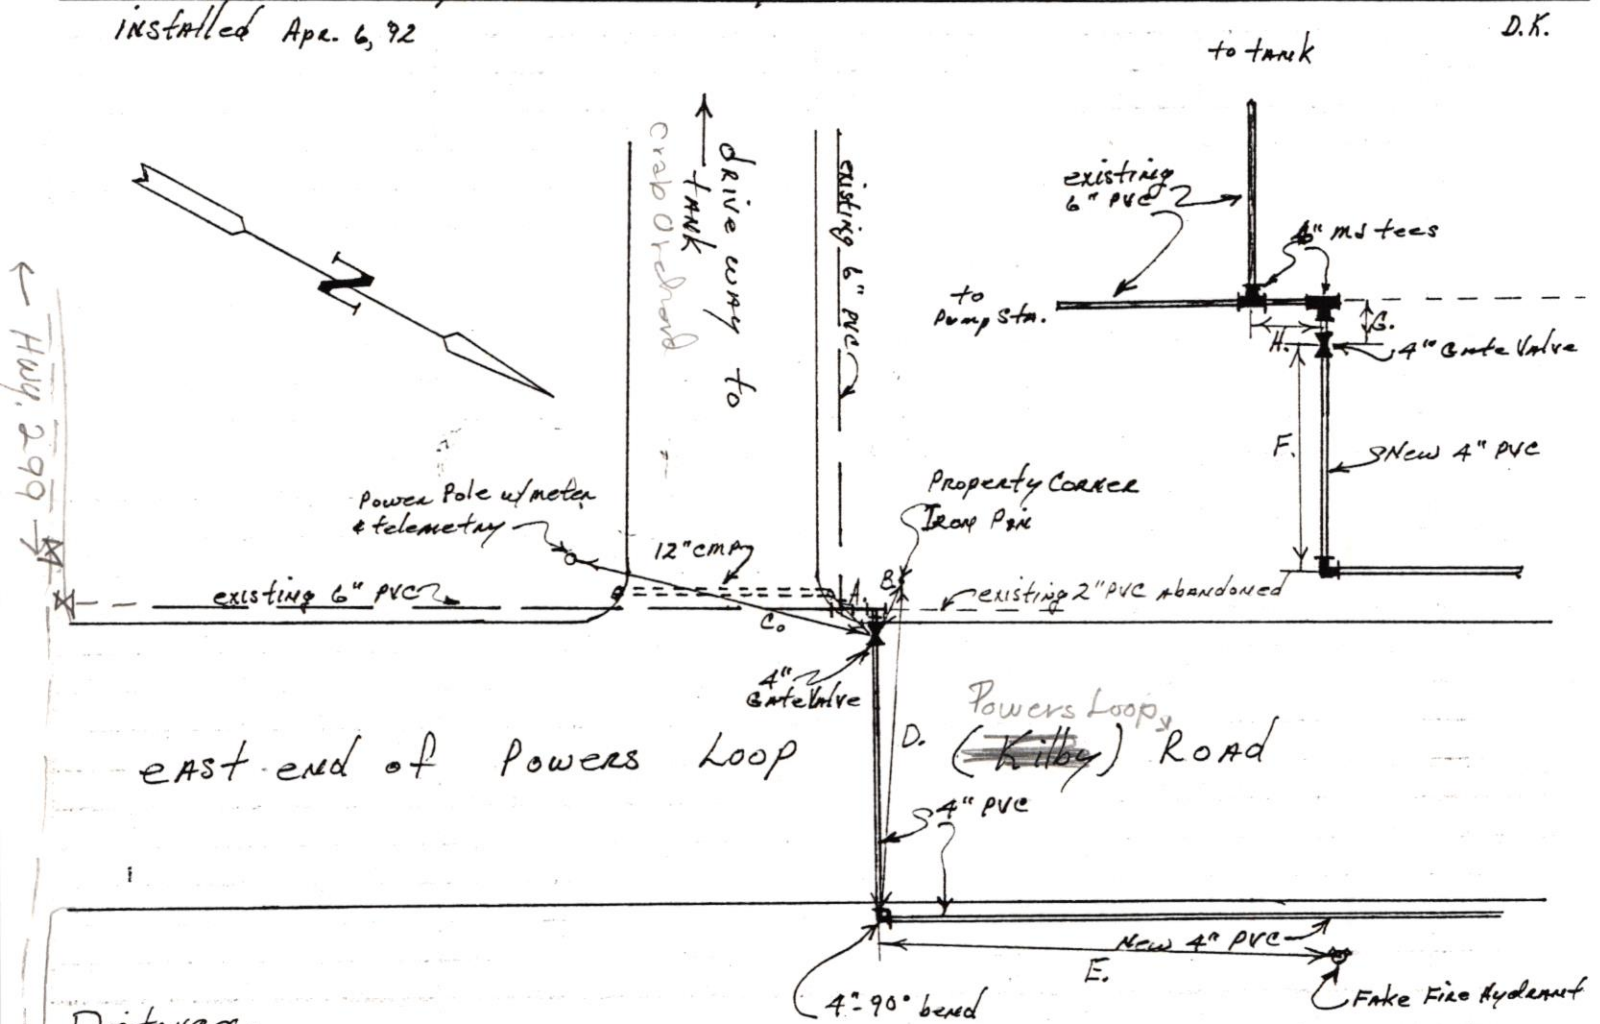

- Distances:
- A. 6'-0" Center of 4" Gate Valve to end of 12" R.C.P.
 - B. 13'-4" Center of 4" Gate Valve to R corner pin.
 - C. 29'-5" Center of 4" Gate Valve to Power Pole w/ meter & telemetry.
 - D. 28'-0" Center of 4" Gate Valve to R corner pin.
 - E. 42'-0" Center of 90° bend to Un-Connected Fire Hydrant
 - F. 15'-6" Center of 4" Gate Valve to center of 90° bend.
 - G. 2'-6" Center of 4" Gate Valve to Center of 6"x6"x4" Tee.
 - H. 3'-0" Center of 6"x6"x6" Tee to 6"x6"x4" Tee.