



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS DATE:

PROJECT NO.: 91017


CHECKED: CONST DATE:

SHEET ____ OF ____

CLIENT: Oakdale / Wolfe Branch U.D. Water Line Replacement Phase 3

SUBJECT: Powers Loop Road (west end) 4" line tie-in and Gate Valve

Installed 4-17-92 D.K.

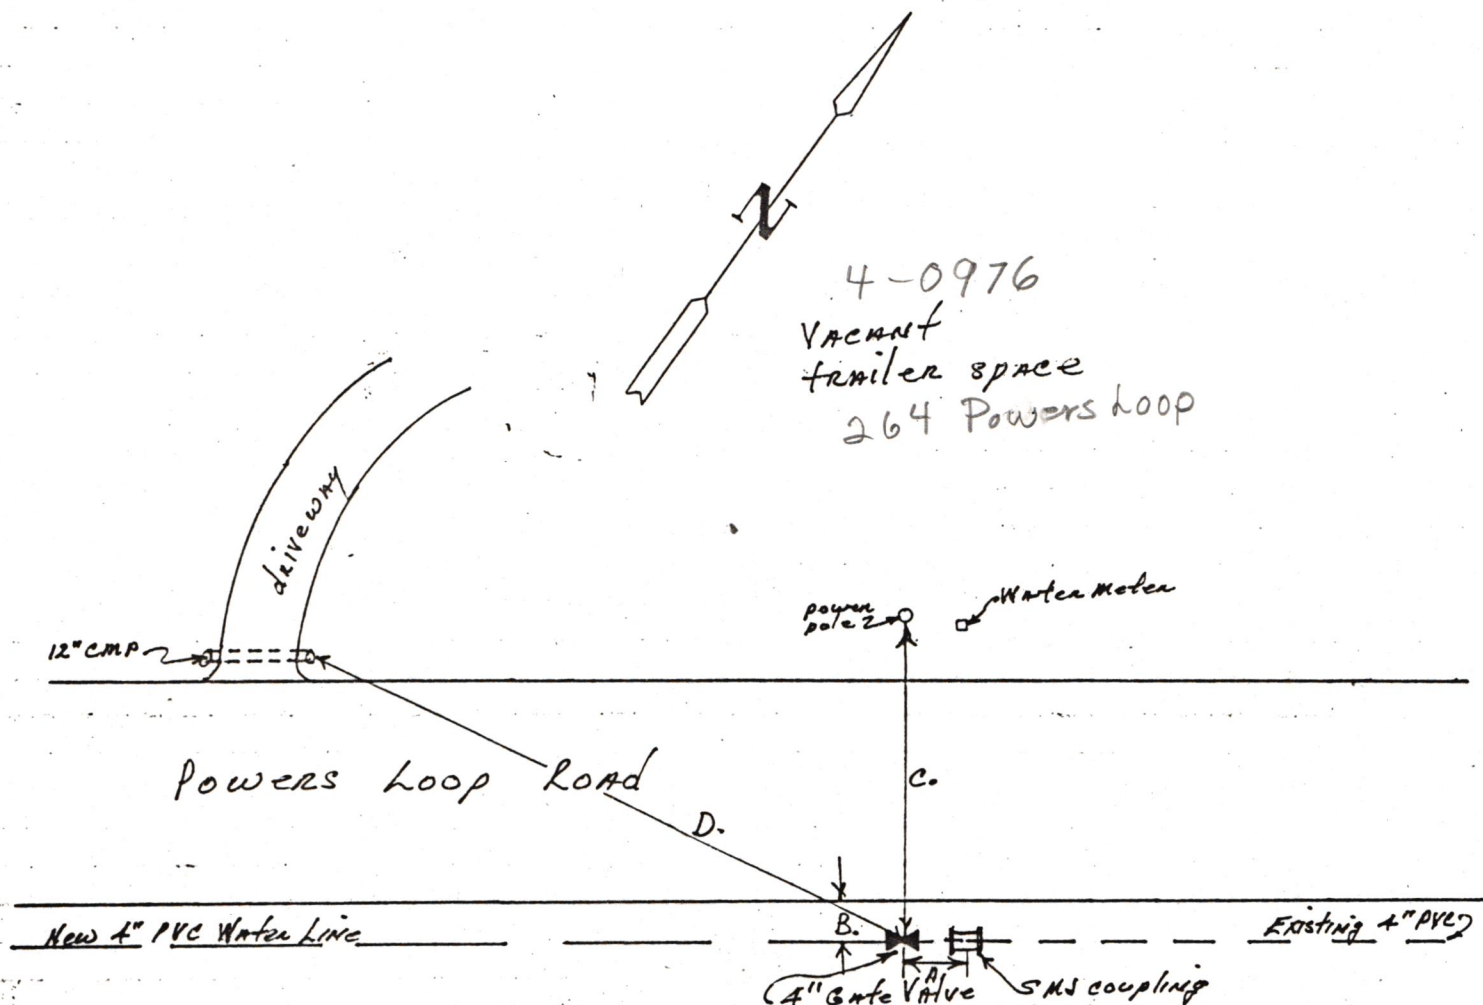

DISTANCES:

- A. 5'-0" 4" Gate Valve to 4" x 12" M.S. Coupling.
- B. 4'-4" 4" Gate Valve to Edge of Pavement.
- C. 29'-7" 4" Gate Valve to Power Pole.
- D. 28'-5" 4" Gate Valve to end of 12" CMP.

